

BLD19-3889 PC1

BUILDING ENERGY ANALYSIS REPORT

Reviewed for Code Compliance
County of Santa Rosa
PRMD

SEP 09 2019

THESE ATTACHMENTS ARE PART OF THE
APPROVED PLANS
DO NOT REMOVE THEM

SEP 09 2019

Resiliency Permit Center

PROJECT:

PRMD
RESILIENCY PERMIT CENTER

96 Dorchester Drive - Corcorans
96 Dorchester Drive
Santa Rosa, CA 95403

Project Designer:

RPS Design
P.O.Box 111
Lagunitas, CA 94938
415-314-0525

Report Prepared by:

Jon Mitguard
Aurora Building Performance
514 C Street
San Rafael, CA 94901
415-457-9778

Job Number:

0619DOR

Date:

6/4/2019

OFFICE

The EnergyPro computer program has been used to perform the calculations summarized in this compliance report. This program has approval and is authorized by the California Energy Commission for use with both the Residential and Nonresidential 2016 Building Energy Efficiency Standards.

This program developed by EnergySoft Software – www.energysoft.com.

OK

ADIA-3889 PC

REVIEWED FOR CALIFORNIA BUILDING ENERGY ANALYSIS REPORT
CORRECTED PERMITS
APPROVED PLANS
THESE ATTACHMENTS ARE PART OF THE PERMIT

DO NOT REMOVE THEM

SEP 02 2010

SEP 18 2010

RESILIENT PERMIT CENTER
PROJECT: RESILIENT PERMIT CENTER

Santa Rosa, CA 95403
86 Dorchester Drive
86 Dorchester Drive - Cotati

Project Designer:

415-314-0525
Lagunitas, CA 94938
P.O. Box 111
RPS Design

Report Prepared by:

415-457-0778
San Rafael, CA 94901
514 C Street
Aurora Building Performance
Jon Miltgard

Job Number:

08190R

Date:

04/2010

The EnergyPlus computer program has been used to perform the calculations described in this compliance report. This program has approval and is authorized by the California Energy Commission for use with both the Residential and Commercial 2010 Building Energy Efficiency Standards.

Compliance
ema

The program developed by EnergySoft Software - www.energysoft.com

OK

TABLE OF CONTENTS

Cover Page	1
Table of Contents	2
Form CF-1R-PRF-01-E Certificate of Compliance	3
Form RMS-1 Residential Measures Summary	11
Form MF-1R Mandatory Measures Summary	12
HVAC System Heating and Cooling Loads Summary	16

TABLE OF CONTENTS

1	Cover Page
2	Table of Contents
3	Form CF-1R-PRF-01-E Certificate of Compliance
11	Form RMS-1 Residential Measures Summary
12	Form MF-1R Mandatory Measures Summary
16	HVAC System Heating and Cooling Loads Summary

4
2019
AD
JCC
11

CERTIFICATE OF COMPLIANCE - RESIDENTIAL PERFORMANCE COMPLIANCE METHOD

Project Name: 96 Dorchester Drive - Corcorans

Calculation Date/Time: 15:31, Tue, Jul 16, 2019

Calculation Description: Title 24 Analysis

Input File Name: 96 Dorchester Drive - Cocorans.ribd16x

GENERAL INFORMATION				
01	Project Name	96 Dorchester Drive - Corcorans		
02	Calculation Description	Title 24 Analysis		
03	Project Location	96 Dorchester Drive		
04	City	Santa Rosa	05	Standards Version
06	Zip Code	95403	07	Compliance Manager Version
08	Climate Zone	CZ2	09	Software Version
10	Building Type	Single Family	11	Front Orientation (deg/Cardinal)
12	Project Scope	Newly Constructed	13	Number of Dwelling Units
14	Total Cond. Floor Area (ft ²)	2131	15	Number of Zones
16	Slab Area (ft ²)	0	17	Number of Stories
18	Addition Cond. Floor Area(ft ²)	n/a	19	Natural Gas Available
20	Addition Slab Area (ft ²)	n/a	21	Glazing Percentage (%)

COMPLIANCE RESULTS	
01	Building Complies with Computer Performance
02	This building incorporates features that require field testing and/or verification by a certified HERS rater under the supervision of a CEC-approved HERS provider.
03	This building incorporates one or more Special Features shown below

ENERGY USE SUMMARY				
04	05	06	07	08
Energy Use (kTDV/ft ² -yr)	Standard Design	Proposed Design	Compliance Margin	Percent Improvement
Space Heating	20.17	19.81	0.36	1.8%
Space Cooling	6.72	6.62	0.10	1.5%
IAQ Ventilation	1.16	1.16	0.00	0.0%
Water Heating	9.03	8.05	0.98	10.9%
Photovoltaic Offset	---	0.00	0.00	---
Compliance Energy Total	37.08	35.64	1.44	3.9%

ENERGY DESIGN RATING

Energy Design Rating (EDR) is an alternate way to express the energy performance of a building using a scoring system where 100 represents the energy performance of the Residential Energy Services (RESNET) reference home characterization of the 2006 International Energy Conservation Code (IECC) with California modeling assumptions. A score of zero represents the energy performance of a building that combines high levels of energy efficiency with renewable generation to "zero out" its TDV energy. Because EDR includes consideration of components not regulated by Title 24, Part 6 (such as domestic appliances and consumer electronics), it is not used to show compliance with Part 6 but may instead be used by local jurisdictions pursuing local ordinances under Title 24, Part 11 (CALGreen).
 As a Standard Design building under the 2016 Building Energy Efficiency Standards is significantly more efficient than the baseline EDR building, the EDR of the Standard Design building is provided for information. Similarly, the EDR score of the Proposed Design is provided separately from the EDR value of installed PV so that the effects of efficiency and renewable energy can both be seen

EDR of Standard Efficiency	EDR of Proposed Efficiency	EDR Value of Proposed PV + Battery	Final Proposed EDR
49.1	48.2	0.0	48.2
<input type="checkbox"/>	Design meets Tier 1 requirement of 15% or greater code compliance margin (CALGreen A4.203.1.2.1) and QII verification prerequisite.		
<input type="checkbox"/>	Design meets Tier 2 requirement of 30% or greater code compliance margin (CALGreen A4.203.1.2.2) and QII verification prerequisite.		
<input type="checkbox"/>	Design meets Zero Net Energy (ZNE) Design Designation requirement for Single Family in climate zone C22 (CALGreen A4.203.1.2.3) including on-site photovoltaic (PV) renewable energy generation sufficient to achieve a Final Energy Design Rating (EDR) of zero or less. The PV System and QII must be verified.		

Notes:
 • Excess PV Generation EDR Credit: Bypassing PV size limit may violate Net Energy Metering (NEM) rules

REQUIRED SPECIAL FEATURES

The following are features that must be installed as condition for meeting the modeled energy performance for this computer analysis.

- Floor has high level of insulation
- Ducts in crawl space

HERS FEATURE SUMMARY

The following is a summary of the features that must be field-verified by a certified HERS Rater as a condition for meeting the modeled energy performance for this computer analysis. Additional detail is provided in the building components tables below.

- Building-level Verifications:**
- IAQ mechanical ventilation
- Cooling System Verifications:**
- Minimum Airflow
 - Fan Efficacy Watts/CFM
- HVAC Distribution System Verifications:**
- Duct Sealing
- Domestic Hot Water System Verifications:**
- -- None --

BUILDING - FEATURES INFORMATION

01	02	03	04	05	06	07
Project Name	Conditioned Floor Area (ft ²)	Number of Dwelling Units	Number of Bedrooms	Number of Zones	Number of Ventilation Cooling Systems	Number of Water Heating Systems
96 Dorchester Drive - Corcorans	2131	1	3	2	0	1

Project Name: 96 Dorchester Drive - Corcorans

Calculation Date/Time: 15:31, Tue, Jul 16, 2019

Calculation Description: Title 24 Analysis

Input File Name: 96 Dorchester Drive - Cocorans.ribd16x

ZONE INFORMATION						
01	02	03	04	05	06	07
Zone Name	Zone Type	HVAC System Name	Zone Floor Area (ft ²)	Avg. Ceiling Height	Water Heating System 1	Water Heating System 2
1st Floor Zone	Conditioned	Res HVAC1	1101	9	DHW Sys 1	n/a
2nd Floor Zone	Conditioned	Res HVAC1	1030	8	DHW Sys 1	n/a

OPAQUE SURFACES							
01	02	03	04	05	06	07	08
Name	Zone	Construction	Azimuth	Orientation	Gross Area (ft ²)	Window & Door Area (ft ²)	Tilt (deg)
Front Wall	1st Floor Zone	R-21 Wall	350	Front	300	45	90
Left Wall	1st Floor Zone	R-21 Wall	80	Left	468	19	90
Back Wall	1st Floor Zone	R-21 Wall	170	Back	457	79	90
Right Wall	1st Floor Zone	R-21 Wall	260	Right	114	48	90
Wall to Garage	1st Floor Zone>> __Garage__	R-21 Wall1	n/a	n/a	315	0	n/a
R-38 Roof	1st Floor Zone	R-38 Roof Attic	n/a	n/a	566	n/a	n/a
Raised Floor	1st Floor Zone	R-25 Floor Crawlspace	n/a	n/a	1101	n/a	n/a
Front Wall 2	2nd Floor Zone	R-21 Wall	350	Front	445	58	90
Left Wall 2	2nd Floor Zone	R-21 Wall	80	Left	207	16	90
BackWall	2nd Floor Zone	R-21 Wall	170	Back	152	46.7	90
Right Wall 2	2nd Floor Zone	R-21 Wall	260	Right	288	16	90
R-38 Roof 2	2nd Floor Zone	R-38 Roof Attic	n/a	n/a	1030	n/a	n/a
Interior Floor	2nd Floor Zone>>1st Floor Zone	R-0 Floor No Crawlspace	n/a	n/a	547	n/a	n/a
Floor over Garage	2nd Floor Zone>> __Garage__	R-19 Floor No Crawlspace	n/a	n/a	483	n/a	n/a
GarageWallFront	__Garage__	Garage Ext Wall	350	Front	193	112	90
GarageWallLeft	__Garage__	Garage Ext Wall	80	Left	27	0	90
GarageWallback	__Garage__	Garage Ext Wall	170	Back	131	13.5	90
GarageWallRight	__Garage__	Garage Ext Wall	260	Right	288	13.5	90
GarageRoof	__Garage__	R-0 Roof Attic	n/a	n/a	158	n/a	n/a

CERTIFICATE OF COMPLIANCE - RESIDENTIAL PERFORMANCE COMPLIANCE METHOD

Project Name: 96 Dorchester Drive - Corcorans

Calculation Date/Time: 15:31, Tue, Jul 16, 2019

Calculation Description: Title 24 Analysis

Input File Name: 96 Dorchester Drive - Cocorans.ribd16x

OPAQUE SURFACES – Cathedral Ceilings									
01	02	03	04	05	06	07	08	09	10
Name	Zone	Type	Orientation	Area (ft ²)	Skylight Area (ft ²)	Roof Rise (x in 12)	Roof Reflectance	Roof Emittance	Cool Roof
R-30 Roof Cath	1st Floor Zone	R-30 Roof Cathedral	Back	356	0	8	0.1	0.85	No

ATTIC							
01	02	03	04	05	06	07	08
Name	Construction	Type	Roof Rise	Roof Reflectance	Roof Emittance	Radiant Barrier	Cool Roof
Attic 1st Floor Zone	Attic Roof1st Floor Zone	Ventilated	4	0.1	0.85	Yes	No
Attic 2nd Floor Zone	Attic Roof2nd Floor Zone	Ventilated	4	0.1	0.85	Yes	No
Attic __Garage__	Attic Garage Roof Cons	Ventilated	4	0.1	0.85	No	No

FENESTRATION / GLAZING									
01	02	03	04	05	06	07	08	09	10
Name	Type	Surface (Orientation-Azimuth)	Width (ft)	Height (ft)	Multiplier	Area (ft ²)	U-factor	SHGC	Exterior Shading
Windows	Window	Front Wall (Front-350)	----	----	1	45.0	0.32	0.25	Insect Screen (default)
Windows 2	Window	Left Wall (Left-80)	----	----	1	19.0	0.32	0.25	Insect Screen (default)
Windows 3	Window	Back Wall (Back-170)	----	----	1	31.0	0.32	0.25	Insect Screen (default)
Windows 4	Window	Back Wall (Back-170)	----	----	1	48.0	0.32	0.25	Insect Screen (default)
Windows 5	Window	Right Wall (Right-260)	----	----	1	48.0	0.32	0.25	Insect Screen (default)
Windows 6	Window	Front Wall 2 (Front-350)	----	----	1	58.0	0.32	0.25	Insect Screen (default)
Windows 7	Window	Left Wall 2 (Left-80)	----	----	1	16.0	0.32	0.25	Insect Screen (default)
Windows 8	Window	BackWall (Back-170)	----	----	1	46.7	0.32	0.25	Insect Screen (default)
Windows 9	Window	Right Wall 2 (Right-260)	----	----	1	16.0	0.32	0.25	Insect Screen (default)
Windows 10	Window	GarageWallback (Back-170)	----	----	1	13.5	0.34	0.33	Insect Screen (default)
Windows 11	Window	GarageWallRight (Right-260)	----	----	1	13.5	0.34	0.33	Insect Screen (default)

OPAQUE DOORS			
01	02	03	04
Name	Side of Building	Area (ft ²)	U-factor
GarageCarDoorFront	GarageWallFront	112.0	0.70

OPAQUE SURFACE CONSTRUCTIONS						
01	02	03	04	05	06	07
Construction Name	Surface Type	Construction Type	Framing	Total Cavity R-value	Winter Design U-factor	Assembly Layers
Garage Ext Wall	Exterior Walls	Wood Framed Wall	2x4 @ 16 in. O.C.	none	0.361	<ul style="list-style-type: none"> • Inside Finish: Gypsum Board • Cavity / Frame: no insul. / 2x4 • Exterior Finish: 3 Coat Stucco
R-0 Roof Attic	Ceilings (below attic)	Wood Framed Ceiling	2x4 @ 24 in. O.C.	none	0.481	<ul style="list-style-type: none"> • Inside Finish: Gypsum Board • Cavity / Frame: no insul. / 2x4
Attic Garage Roof Cons	Attic Roofs	Wood Framed Ceiling	2x4 Top Chord of Roof Truss @ 24 in. O.C.	none	0.644	<ul style="list-style-type: none"> • Cavity / Frame: no insul. / 2x4 Top Chrd • Roof Deck: Wood Siding/sheathing/decking • Roofing: Light Roof (Asphalt Shingle)
Attic Roof1st Floor Zone	Attic Roofs	Wood Framed Ceiling	2x4 Top Chord of Roof Truss @ 24 in. O.C.	none	0.644	<ul style="list-style-type: none"> • Cavity / Frame: no insul. / 2x4 Top Chrd • Roof Deck: Wood Siding/sheathing/decking • Roofing: Light Roof (Asphalt Shingle)
R-30 Roof Cathedral	Cathedral Ceilings	Wood Framed Ceiling	2x12 @ 16 in. O.C.	R 30	0.036	<ul style="list-style-type: none"> • Inside Finish: Gypsum Board • Cavity / Frame: R-30 / 2x12 • Roof Deck: Wood Siding/sheathing/decking • Roofing: Light Roof (Asphalt Shingle)
R-38 Roof Attic	Ceilings (below attic)	Wood Framed Ceiling	2x4 @ 24 in. O.C.	R 38	0.025	<ul style="list-style-type: none"> • Inside Finish: Gypsum Board • Cavity / Frame: R-9.1 / 2x4 • Over Ceiling Joists: R-28.9 insul.
R-21 Wall	Exterior Walls	Wood Framed Wall	2x6 @ 16 in. O.C.	R 21	0.069	<ul style="list-style-type: none"> • Inside Finish: Gypsum Board • Cavity / Frame: R-21 / 2x6 • Exterior Finish: 3 Coat Stucco
R-21 Wall1	Interior Walls	Wood Framed Wall	2x6 @ 16 in. O.C.	R 21	0.064	<ul style="list-style-type: none"> • Inside Finish: Gypsum Board • Cavity / Frame: R-21 / 2x6 • Other Side Finish: Gypsum Board
R-25 Floor Crawlspace	Floors Over Crawlspace	Wood Framed Floor	2x10 @ 16 in. O.C.	R 25	0.038	<ul style="list-style-type: none"> • Floor Surface: Carpeted • Floor Deck: Wood Siding/sheathing/decking • Cavity / Frame: R-25 / 2x10
Attic Roof2nd Floor Zone	Attic Roofs	Wood Framed Ceiling	2x4 Top Chord of Roof Truss @ 24 in. O.C.	none	0.644	<ul style="list-style-type: none"> • Cavity / Frame: no insul. / 2x4 Top Chrd • Roof Deck: Wood Siding/sheathing/decking • Roofing: Light Roof (Asphalt Shingle)
R-0 Floor No Crawlspace	Interior Floors	Wood Framed Floor	2x12 @ 16 in. O.C.	none	0.196	<ul style="list-style-type: none"> • Floor Surface: Carpeted • Floor Deck: Wood Siding/sheathing/decking • Cavity / Frame: no insul. / 2x12 • Ceiling Below Finish: Gypsum Board
R-19 Floor No Crawlspace	Interior Floors	Wood Framed Floor	2x6 @ 16 in. O.C.	R 19 in 5-1/2 in. cavity (R-18)	0.049	<ul style="list-style-type: none"> • Floor Surface: Carpeted • Floor Deck: Wood Siding/sheathing/decking • Cavity / Frame: R-19 in 5-1/2 in. (R-18) / 2x6 • Ceiling Below Finish: Gypsum Board

CERTIFICATE OF COMPLIANCE - RESIDENTIAL PERFORMANCE COMPLIANCE METHOD

Project Name: 96 Dorchester Drive - Corcorans

Calculation Date/Time: 15:31, Tue, Jul 16, 2019

Calculation Description: Title 24 Analysis

Input File Name: 96 Dorchester Drive - Cocorans.ribd16x

BUILDING ENVELOPE - HERS VERIFICATION			
01	02	03	04
Quality Insulation Installation (QII)	Quality Installation of Spray Foam Insulation	Building Envelope Air Leakage	CFM50
Not Required	Not Required	Not Required	n/a

WATER HEATING SYSTEMS					
01	02	03	04	05	06
Name	System Type	Distribution Type	Water Heater	Number of Heaters	Solar Fraction (%)
DHW Sys 1	DHW	Standard	DHW Heater 1 (1)	1	.0%

WATER HEATERS											
01	02	03	04	05	06	07	08	09	10	11	12
Name	Heater Element Type	Tank Type	Number of Units	Tank Volume (gal)	Uniform Energy Factor / Energy Factor / Efficiency	Input Rating / Pilot / Thermal Efficiency	Tank Insulation R-value (Int/Ext)	Standby Loss / Recovery Eff	First Hour Rating / Flow Rate	NEEA Heat Pump Brand / Model / Other	Tank Location or Ambient Condition
DHW Heater 1	Gas	Small Instantaneous	1	0	0.92 EF	<= 200 kBtu/hr	R-0/R-0	0	n/a	n/a	n/a

SPACE CONDITIONING SYSTEMS					
01	02	03	04	05	06
SC Sys Name	System Type	Heating Unit Name	Cooling Unit Name	Fan Name	Distribution Name
Res HVAC1	Other Heating and Cooling System	Heating Component 1	Cooling Component 1	HVAC Fan 1	Air Distribution System 1

HVAC - HEATING UNIT TYPES			
01	02	03	04
Name	System Type	Number of Units	Efficiency
Heating Component 1	CntrlFurnace	1	93.1 AFUE

HVAC - COOLING UNIT TYPES							
01	02	03	04	05	06	07	08
Name	System Type	Number of Units	Efficiency		Zonally Controlled	Compressor Type	HERS Verification
			EER	SEER			
Cooling Component 1	SplitAirCond	1	11.5	14	Not Zonal	Single Speed	Cooling Component 1-hers-cool

CERTIFICATE OF COMPLIANCE - RESIDENTIAL PERFORMANCE COMPLIANCE METHOD

CF1R-PRF-01

Project Name: 96 Dorchester Drive - Corcorans

Calculation Date/Time: 15:31, Tue, Jul 16, 2019

Page 7 of 8

Calculation Description: Title 24 Analysis

Input File Name: 96 Dorchester Drive - Cocorans.ribd16x

HVAC COOLING - HERS VERIFICATION					
01	02	03	04	05	06
Name	Verified Airflow	Airflow Target	Verified EER	Verified SEER	Verified Refrigerant Charge
Cooling Component 1-hers-cool	Required	350	Not Required	Not Required	Not Required

HVAC - DISTRIBUTION SYSTEMS						
01	02	03	04	05	06	07
Name	Type	Duct Leakage	Insulation R-value	Duct Location	Bypass Duct	HERS Verification
Air Distribution System 1	DuctsCrawl	Sealed and tested	6	Crawl space	None	Air Distribution System 1-hers-dist

HVAC DISTRIBUTION - HERS VERIFICATION							
01	02	03	04	05	06	07	08
Name	Duct Leakage Verification	Duct Leakage Target (%)	Verified Duct Location	Verified Duct Design	Buried Ducts	Deeply Buried Ducts	Low-leakage Air Handler
Air Distribution System 1-hers-dist	Required	5.0	Not Required	Not Required	Not Required	Not Required	n/a

HVAC - FAN SYSTEMS			
01	02	03	04
Name	Type	Fan Power (Watts/CFM)	HERS Verification
HVAC Fan 1	Single Speed PSC Furnace Fan	0.58	HVAC Fan 1-hers-fan

HVAC FAN SYSTEMS - HERS VERIFICATION		
01	02	03
Name	Verified Fan Watt Draw	Required Fan Efficiency (Watts/CFM)
HVAC Fan 1-hers-fan	Required	0.58

IAQ (Indoor Air Quality) FANS					
01	02	03	04	05	06
Dwelling Unit	IAQ CFM	IAQ Watts/CFM	IAQ Fan Type	IAQ Recovery Effectiveness(%)	HERS Verification
SFam IAQVentRpt	51	0.25	Default	0	Required

CERTIFICATE OF COMPLIANCE - RESIDENTIAL PERFORMANCE COMPLIANCE METHOD

Project Name: 96 Dorchester Drive - Corcorans

Calculation Date/Time: 15:31, Tue, Jul 16, 2019

Calculation Description: Title 24 Analysis

Input File Name: 96 Dorchester Drive - Cocorans.ribd16x

DOCUMENTATION AUTHOR'S DECLARATION STATEMENT

1. I certify that this Certificate of Compliance documentation is accurate and complete.

Documentation Author Name: Jonathan Mitguard	Documentation Author Signature: <i>Jonathan Mitguard</i>
Company: Aurora Building Performance	Signature Date: 2019-07-16 16:08:53
Address: 514 C Street	CEA/HERS Certification Identification (If applicable): cc2005654
City/State/Zip: San Rafael, CA 94901	Phone: 415-457-9778

RESPONSIBLE PERSON'S DECLARATION STATEMENT

I certify the following under penalty of perjury, under the laws of the State of California:

1. I am eligible under Division 3 of the Business and Professions Code to accept responsibility for the building design identified on this Certificate of Compliance.
2. I certify that the energy features and performance specifications identified on this Certificate of Compliance conform to the requirements of Title 24, Part 1 and Part 6 of the California Code of Regulations.
3. The building design features or system design features identified on this Certificate of Compliance are consistent with the information provided on other applicable compliance documents, worksheets, calculations, plans and specifications submitted to the enforcement agency for approval with this building permit application.

Responsible Designer Name: Robert Suttman	Responsible Designer Signature: <i>Robert Suttman</i>
Company: RPS Design	Date Signed: 2019-07-16 16:14:51
Address: PO Box 111	License: C-36187
City/State/Zip: Lagunitas, CA 94938	Phone: 415-314-0525

Digitally signed by CalCERTS. This digital signature is provided in order to secure the content of this registered document, and in no way implies Registration Provider responsibility for the accuracy of the information.



RESIDENTIAL MEASURES SUMMARY

RMS-1

Project Name 96 Dorchester Drive - Corcorans	Building Type <input checked="" type="checkbox"/> Single Family <input type="checkbox"/> Addition Alone <input type="checkbox"/> Multi Family <input type="checkbox"/> Existing+ Addition/Alteration	Date 6/4/2019
Project Address 96 Dorchester Drive Santa Rosa	California Energy Climate Zone CA Climate Zone 02	Total Cond. Floor Area 2,131
	Addition n/a	# of Units 1

INSULATION		Cavity	Area (ft ²)	Special Features	Status
Roof	Wood Framed Rafter	R 30	356		New
Roof	Wood Framed Attic	R 38	1,596		New
Wall	Wood Framed	R 21	2,418		New
Floor	Wood Framed w/Crawl Space	R 25	1,101		New
Demising	Wood Framed w/o Crawl Space	- no insulation	547		New
Demising	Wood Framed w/o Crawl Space	R 19 in 5-1/2 ii	483		New

FENESTRATION		Total Area:	Glazing Percentage:	New/Altered Average U-Factor:			
Orientation	Area(ft ²)	U-Fac	SHGC	Overhang	Sidefins	Exterior Shades	Status
Front (S)	103.0	0.320	0.25	none	none	Bug Screen	New
Left (W)	35.0	0.320	0.25	none	none	Bug Screen	New
Rear (N)	125.7	0.320	0.25	none	none	Bug Screen	New
Right (E)	64.0	0.320	0.25	none	none	Bug Screen	New

HVAC SYSTEMS						
Qty.	Heating	Min. Eff	Cooling	Min. Eff	Thermostat	Status
1	Central Furnace	93% AFUE	Split Air Conditioner	14.0 SEER	Setback	New

HVAC DISTRIBUTION					
Location	Heating	Cooling	Duct Location	Duct R-Value	Status
Res HVAC	Ducted	Ducted	Crawlspace	6.0	New

WATER HEATING					
Qty.	Type	Gallons	Min. Eff	Distribution	Status
1	Small Instantaneous Gas	0	0.92	Standard	New



2016 Low-Rise Residential Mandatory Measures Summary

*NOTE: Low-rise residential buildings subject to the Energy Standards must comply with all applicable mandatory measures, regardless of the compliance approach used. Review the respective section for more information. *Exceptions may apply.
(Revised 04/2017)*

Building Envelope Measures:	
§ 110.6(a)1:	Air Leakage. Manufactured fenestration, exterior doors, and exterior pet doors must limit air leakage to 0.3 cfm/ft ² or less when tested per NFRC-400 or ASTM E283 or AAMA/WDMA/CSA 101/I.S.2/A440-2011.*
§ 110.6(a)5:	Labeling. Fenestration products must have a label meeting the requirements of § 10-111(a).
§ 110.6(b):	Field fabricated exterior doors and fenestration products must use U-factors and solar heat gain coefficient (SHGC) values from TABLES 110.6-A and 110.6-B for compliance and must be caulked and/or weatherstripped.*
§ 110.7:	Air Leakage. All joints, penetrations, and other openings in the building envelope that are potential sources of air leakage must be caulked, gasketed, or weather stripped.
§ 110.8(a):	Insulation Certification by Manufacturers. Insulation specified or installed must meet Standards for Insulating Material.
§ 110.8(g):	Insulation Requirements for Heated Slab Floors. Heated slab floors must be insulated per the requirements of § 110.8(g).
§ 110.8(i):	Roofing Products Solar Reflectance and Thermal Emittance. The thermal emittance and aged solar reflectance values of the roofing material must meet the requirements of § 110.8(i) when the installation of a cool roof is specified on the CF1R.
§ 110.8(j):	Radiant Barrier. A radiant barrier must have an emittance of 0.05 or less and be certified to the Department of Consumer Affairs.
§ 150.0(a):	Ceiling and Rafter Roof Insulation. Minimum R-22 insulation in wood-frame ceiling; or the weighted average U-factor must not exceed 0.043. Minimum R-19 or weighted average U-factor of 0.054 or less in a rafter roof alteration. Attic access doors must have permanently attached insulation using adhesive or mechanical fasteners. The attic access must be gasketed to prevent air leakage. Insulation must be installed in direct contact with a continuous roof or ceiling which is sealed to limit infiltration and exfiltration as specified in § 110.7, including but not limited to placing insulation either above or below the roof deck or on top of a drywall ceiling.*
§ 150.0(b):	Loose-fill Insulation. Loose fill insulation must meet the manufacturer's required density for the labeled R-value.
§ 150.0(c):	Above Grade Wall Insulation. Minimum R-13 insulation in 2x4 inch wood framing wall or have a U-factor of 0.102 or less (R-19 in 2x6 or U-factor of 0.074 or less). Opaque non-framed assemblies must have an overall assembly U-factor not exceeding 0.102, equivalent to an installed value of R-13 in a wood framed assembly.*
§ 150.0(d):	Raised-floor Insulation. Minimum R-19 insulation in raised wood framed floor or 0.037 maximum U-factor.*
§ 150.0(f):	Slab Edge Insulation. Slab edge insulation must meet all of the following: have a water absorption rate, for the insulation material alone without facings, no greater than 0.3%; have a water vapor permeance no greater than 2.0 perm/inch; be protected from physical damage and UV light deterioration; and, when installed as part of a heated slab floor, meet the requirements of § 110.8(g).
§ 150.0(g)1:	Vapor Retarder. In Climate Zones 1-16, the earth floor of unvented crawl space must be covered with a Class I or Class II vapor retarder. This requirement also applies to controlled ventilation crawl space for buildings complying with the exception to § 150.0(d).
§ 150.0(g)2:	Vapor Retarder. In Climate Zones 14 and 16, a Class I or Class II vapor retarder must be installed on the conditioned space side of all insulation in all exterior walls, vented attics, and unvented attics with air-permeable insulation.
§ 150.0(q):	Fenestration Products. Fenestration, including skylights, separating conditioned space from unconditioned space or outdoors must have a maximum U-factor of 0.58; or the weighted average U-factor of all fenestration must not exceed 0.58.*
Fireplaces, Decorative Gas Appliances, and Gas Log Measures:	
§ 150.0(e)1A:	Closable Doors. Masonry or factory-built fireplaces must have a closable metal or glass door covering the entire opening of the firebox.
§ 150.0(e)1B:	Combustion Intake. Masonry or factory-built fireplaces must have a combustion outside air intake, which is at least six square inches in area and is equipped with a readily accessible, operable, and tight-fitting damper or combustion-air control device.*
§ 150.0(e)1C:	Flue Damper. Masonry or factory-built fireplaces must have a flue damper with a readily accessible control.*
§ 150.0(e)2:	Pilot Light. Continuous burning pilot lights and the use of indoor air for cooling a firebox jacket, when that indoor air is vented to the outside of the building, are prohibited.
Space Conditioning, Water Heating, and Plumbing System Measures:	
§ 110.0-§ 110.3:	Certification. Heating, ventilation and air conditioning (HVAC) equipment, water heaters, showerheads, faucets, and all other regulated appliances must be certified by the manufacturer to the Energy Commission.*
§ 110.2(a):	HVAC Efficiency. Equipment must meet the applicable efficiency requirements in TABLE 110.2-A through TABLE 110.2-K.*
§ 110.2(b):	Controls for Heat Pumps with Supplementary Electric Resistance Heaters. Heat pumps with supplementary electric resistance heaters must have controls that prevent supplementary heater operation when the heating load can be met by the heat pump alone; and in which the cut-on temperature for compression heating is higher than the cut-on temperature for supplementary heating, and the cut-off temperature for compression heating is higher than the cut-off temperature for supplementary heating.*
§ 110.2(c):	Thermostats. All unitary heating or cooling systems not controlled by a central energy management control system (EMCS) must have a setback thermostat.*
§ 110.3(c)5:	Water Heating Recirculation Loops Serving Multiple Dwelling Units. Water heating recirculation loops serving multiple dwelling units must meet the air release valve, backflow prevention, pump priming, pump isolation valve, and recirculation loop connection requirements of § 110.3(c)5.
§ 110.3(c)7:	Isolation Valves. Instantaneous water heaters with an input rating greater than 6.8 kBtu/hr (2 kW) must have isolation valves with hose bibbs or other fittings on both cold water and hot water lines of water heating systems to allow for water tank flushing when the valves are closed.
§ 110.5:	Pilot Lights. Continuously burning pilot lights are prohibited for natural gas: fan-type central furnaces; household cooking appliances (appliances without an electrical supply voltage connection with pilot lights that consume less than 150 Btu/hr are exempt); and pool and spa heaters.*
§ 150.0(h)1:	Building Cooling and Heating Loads. Heating and/or cooling loads are calculated in accordance with ASHRAE Handbook, Equipment Volume, Applications Volume, and Fundamentals Volume; SMACNA Residential Comfort System Installation Standards Manual; or ACCA Manual J using design conditions specified in § 150.0(h)2.



2016 Low-Rise Residential Mandatory Measures Summary

§ 150.0(h)3A:	Clearances. Installed air conditioner and heat pump outdoor condensing units must have a clearance of at least 5 feet from the outlet of any dryer vent.
§ 150.0(h)3B:	Liquid Line Drier. Installed air conditioner and heat pump systems must be equipped with liquid line filter driers if required, as specified by manufacturer's instructions.
§ 150.0(j)1:	Storage Tank Insulation. Unfired hot water tanks, such as storage tanks and backup storage tanks for solar water-heating systems, must have R-12 external insulation or R-16 internal insulation where the internal insulation R-value is indicated on the exterior of the tank.
§ 150.0(j)2A:	Water piping and cooling system line insulation. For domestic hot water system piping, whether buried or unburied, all of the following must be insulated according to the requirements of TABLE 120.3-A: the first 5 feet of hot and cold water pipes from the storage tank; all piping with a nominal diameter of 3/4 inch or larger; all piping associated with a domestic hot water recirculation system regardless of the pipe diameter; piping from the heating source to storage tank or between tanks; piping buried below grade; and all hot water pipes from the heating source to kitchen fixtures.*
§ 150.0(j)2B:	Water piping and cooling system line insulation. All domestic hot water pipes that are buried below grade must be installed in a water proof and non-crushable casing or sleeve.*
§ 150.0(j)2C:	Water piping and cooling system line insulation. Pipe for cooling system lines must be insulated as specified in § 150.0(j)2A. Distribution piping for steam and hydronic heating systems or hot water systems must meet the requirements in TABLE 120.3-A.*
§ 150.0(j)3:	Insulation Protection. Insulation must be protected from damage, including that due to sunlight, moisture, equipment maintenance, and wind.
§ 150.0(j)3A:	Insulation Protection. Insulation exposed to weather must be installed with a cover suitable for outdoor service. For example, protected by aluminum, sheet metal, painted canvas, or plastic cover. The cover must be water retardant and provide shielding from solar radiation that can cause degradation of the material.
§ 150.0(j)3B:	Insulation Protection. Insulation covering chilled water piping and refrigerant suction piping located outside the conditioned space must have a Class I or Class II vapor retarder.
§ 150.0(n)1:	Gas or Propane Systems. Systems using gas or propane water heaters to serve individual dwelling units must include all of the following: a 120V electrical receptacle within 3 feet of the water heater; a Category III or IV vent, or a Type B vent with straight pipe between the outside termination and the space where the water heater is installed; a condensate drain that is no more than 2 inches higher than the base of the water heater, and allows natural draining without pump assistance; and a gas supply line with a capacity of at least 200,000 Btu/hr.
§ 150.0(n)2:	Recirculating Loops. Recirculating loops serving multiple dwelling units must meet the requirements of § 110.3(c)5.
§ 150.0(n)3:	Solar Water-heating Systems. Solar water-heating systems and collectors must be certified and rated by the Solar Rating and Certification Corporation (SRCC) or by a listing agency that is approved by the Executive Director.
Ducts and Fans Measures:	
§ 110.8(d)3:	Ducts. Insulation installed on an existing space-conditioning duct must comply with § 604.0 of the California Mechanical Code (CMC). If a contractor installs the insulation, the contractor must certify to the customer, in writing, that the insulation meets this requirement.
§ 150.0(m)1:	CMC Compliance. All air-distribution system ducts and plenums must be installed, sealed, and insulated to meet the requirements of CMC §§ 601.0, 602.0, 603.0, 604.0, 605.0 and ANSI/SMACNA-006-2006 HVAC Duct Construction Standards Metal and Flexible 3rd Edition. Portions of supply-air and return-air ducts and plenums must be insulated to a minimum installed level of R-6.0 (or higher if required by CMC § 605.0) or a minimum installed level of R-4.2 when entirely in conditioned space as confirmed through field verification and diagnostic testing (RA3.1.4.3.8). Connections of metal ducts and inner core of flexible ducts must be mechanically fastened. Openings must be sealed with mastic, tape, or other duct-closure system that meets the applicable requirements of UL 181, UL 181A, or UL 181B or aerosol sealant that meets the requirements of UL 723. If mastic or tape is used to seal openings greater than 1/4 inch, the combination of mastic and either mesh or tape must be used. Building cavities, support platforms for air handlers, and plenums designed or constructed with materials other than sealed sheet metal, duct board or flexible duct must not be used for conveying conditioned air. Building cavities and support platforms may contain ducts. Ducts installed in cavities and support platforms must not be compressed to cause reductions in the cross-sectional area of the ducts.*
§ 150.0(m)2:	Factory-Fabricated Duct Systems. Factory-fabricated duct systems must comply with applicable requirements for duct construction, connections, and closures; joints and seams of duct systems and their components must not be sealed with cloth back rubber adhesive duct tapes unless such tape is used in combination with mastic and draw bands.
§ 150.0(m)3:	Field-Fabricated Duct Systems. Field-fabricated duct systems must comply with applicable requirements for: pressure-sensitive tapes, mastics, sealants, and other requirements specified for duct construction.
§ 150.0(m)7:	Backdraft Dampers. All fan systems that exchange air between the conditioned space and the outside of the building must have backdraft or automatic dampers.
§ 150.0(m)8:	Gravity Ventilation Dampers. Gravity ventilating systems serving conditioned space must have either automatic or readily accessible, manually operated dampers in all openings to the outside, except combustion inlet and outlet air openings and elevator shaft vents.
§ 150.0(m)9:	Protection of Insulation. Insulation must be protected from damage, including that due to sunlight, moisture, equipment maintenance, and wind. Insulation exposed to weather must be suitable for outdoor service. For example, protected by aluminum, sheet metal, painted canvas, or plastic cover. Cellular foam insulation must be protected as above or painted with a coating that is water retardant and provides shielding from solar radiation.
§ 150.0(m)10:	Porous Inner Core Flex Duct. Porous inner core flex duct must have a non-porous layer between the inner core and outer vapor barrier.
§ 150.0(m)11:	Duct System Sealing and Leakage Test. When space conditioning systems use forced air duct systems to supply conditioned air to an occupiable space, the ducts must be sealed and duct leakage tested, as confirmed through field verification and diagnostic testing, in accordance with § 150.0(m)11 and Reference Residential Appendix RA3.
§ 150.0(m)12:	Air Filtration. Mechanical systems that supply air to an occupiable space through ductwork exceeding 10 feet in length and through a thermal conditioning component, except evaporative coolers, must be provided with air filter devices that meet the design, installation, efficiency, pressure drop, and labeling requirements of § 150.0(m)12.



2016 Low-Rise Residential Mandatory Measures Summary

§ 150.0(m)13:	Duct System Sizing and Air Filter Grille Sizing. Space conditioning systems that use forced air ducts to supply cooling to an occupiable space must have a hole for the placement of a static pressure probe (HSPP), or a permanently installed static pressure probe (PSPP) in the supply plenum. The space conditioning system must also demonstrate airflow ≥ 350 CFM per ton of nominal cooling capacity through the return grilles, and an air-handling unit fan efficacy ≤ 0.58 W/CFM as confirmed by field verification and diagnostic testing, in accordance with Reference Residential Appendix RA3.3. This applies to both single zone central forced air systems and every zone for zonally controlled central forced air systems.*
§150.0(o):	Ventilation for Indoor Air Quality. All dwelling units must meet the requirements of ASHRAE Standard 62.2. Neither window operation nor continuous operation of central forced air system air handlers used in central fan integrated ventilation systems are permissible methods of providing whole-building ventilation.
§ 150.0(o)1A:	Field Verification and Diagnostic Testing. Whole-building ventilation airflow must be confirmed through field verification and diagnostic testing, in accordance with Reference Residential Appendix RA3.7.
Pool and Spa Systems and Equipment Measures:	
§ 110.4(a):	Certification by Manufacturers. Any pool or spa heating system or equipment must be certified to have all of the following: a thermal efficiency that complies with the Appliance Efficiency Regulations; an on-off switch mounted outside of the heater that allows shutting off the heater without adjusting the thermostat setting; a permanent weatherproof plate or card with operating instructions; and must not use electric resistance heating.*
§ 110.4(b)1:	Piping. Any pool or spa heating equipment must be installed with at least 36 inches of pipe between the filter and the heater, or dedicated suction and return lines, or built-in or built-up connections to allow for future solar heating.
§ 110.4(b)2:	Covers. Outdoor pools or spas that have a heat pump or gas heater must have a cover.
§ 110.4(b)3:	Directional inlets and time switches for pools. Pools must have directional inlets that adequately mix the pool water, and a time switch that will allow all pumps to be set or programmed to run only during off-peak electric demand periods.
§ 110.5:	Pilot Light. Natural gas pool and spa heaters must not have a continuously burning pilot light.
§ 150.0(p):	Pool Systems and Equipment Installation. Residential pool systems or equipment must meet the specified requirements for pump sizing, flow rate, piping, filters, and valves.*
Lighting Measures:	
§ 110.9:	Lighting Controls and Components. All lighting control devices and systems, ballasts, and luminaires must meet the applicable requirements of § 110.9.*
§ 110.9(e):	JA8 High Efficacy Light Sources. To qualify as a JA8 high efficacy light source for compliance with § 150.0(k), a residential light source must be certified to the Energy Commission according to Reference Joint Appendix JA8.
§ 150.0(k)1A:	Luminaire Efficacy. All installed luminaires must be high efficacy in accordance with TABLE 150.0-A.
§ 150.0(k)1B:	Blank Electrical Boxes. The number of electrical boxes that are more than 5 feet above the finished floor and do not contain a luminaire or other device must be no greater than the number of bedrooms. These electrical boxes must be served by a dimmer, vacancy sensor control, or fan speed control.
§ 150.0(k)1C:	Recessed Downlight Luminaires in Ceilings. Luminaires recessed into ceilings must meet all of the requirements for: insulation contact (IC) labeling; air leakage; sealing; maintenance; and socket and light source as described in § 150.0(k)1C. A JA8-2016-E light source rated for elevated temperature must be installed by final inspection in all recessed downlight luminaires in ceilings.
§ 150.0(k)1D:	Electronic Ballasts. Ballasts for fluorescent lamps rated 13 watts or greater must be electronic and must have an output frequency no less than 20 kHz.
§ 150.0(k)1E:	Night Lights. Permanently installed night lights and night lights integral to installed luminaires or exhaust fans must be rated to consume no more than 5 watts of power per luminaire or exhaust fan as determined in accordance with § 130.0(c). Night lights do not need to be controlled by vacancy sensors.
§ 150.0(k)1F:	Lighting Integral to Exhaust Fans. Lighting integral to exhaust fans (except when installed by the manufacturer in kitchen exhaust hoods) must meet the applicable requirements of § 150.0(k).*
§ 150.0(k)1G:	Screw based luminaires. Screw based luminaires must not be recessed downlight luminaires in ceilings and must contain lamps that comply with Reference Joint Appendix JA8. Installed lamps must be marked with "JA8-2016" or "JA8-2016-E" as specified in Reference Joint Appendix JA8.*
§ 150.0(k)1H:	Enclosed Luminaires. Light sources installed in enclosed luminaires must be JA8 compliant and must be marked with "JA8-2016-E."
§ 150.0(k)2A:	Interior Switches and Controls. All forward phase cut dimmers used with LED light sources must comply with NEMA SSL 7A.
§ 150.0(k)2B:	Interior Switches and Controls. Exhaust fans must be switched separately from lighting systems.*
§ 150.0(k)2C:	Interior Switches and Controls. Luminaires must be switched with readily accessible controls that permit the luminaires to be manually switched ON and OFF.
§ 150.0(k)2D:	Interior Switches and Controls. Controls and equipment must be installed in accordance with manufacturer's instructions.
§ 150.0(k)2E:	Interior Switches and Controls. No control must bypass a dimmer or vacancy sensor function if the control is installed to comply with § 150.0(k).
§ 150.0(k)2F:	Interior Switches and Controls. Lighting controls must comply with the applicable requirements of § 110.9.
§ 150.0(k)2G:	Interior Switches and Controls. An energy management control system (EMCS) may be used to comply with dimmer requirements if it: functions as a dimmer according to § 110.9; meets the Installation Certificate requirements of § 130.4; meets the EMCS requirements of § 130.5(f); and meets all other requirements in § 150.0(k)2.
§ 150.0(k)2H:	Interior Switches and Controls. An EMCS may be used to comply with vacancy sensor requirements in § 150.0(k) if it meets all of the following: it functions as a vacancy sensor according to § 110.9; the Installation Certificate requirements of § 130.4; the EMCS requirements of § 130.5(f); and all other requirements in § 150.0(k)2.
§ 150.0(k)2I:	Interior Switches and Controls. A multiscene programmable controller may be used to comply with dimmer requirements in § 150.0(k) if it provides the functionality of a dimmer according to § 110.9, and complies with all other applicable requirements in § 150.0(k)2.



2016 Low-Rise Residential Mandatory Measures Summary

§ 150.0(k)2J:	Interior Switches and Controls. In bathrooms, garages, laundry rooms, and utility rooms, at least one luminaire in each of these spaces must be controlled by a vacancy sensor.
§ 150.0(k)2K:	Interior Switches and Controls. Dimmers or vacancy sensors must control all luminaires required to have light sources compliant with Reference Joint Appendix JA8, except luminaires in closets less than 70 square feet and luminaires in hallways.*
§ 150.0(k)2L:	Interior Switches and Controls. Undercabinet lighting must be switched separately from other lighting systems.
§ 150.0(k)3A:	Residential Outdoor Lighting. For single-family residential buildings, outdoor lighting permanently mounted to a residential building, or to other buildings on the same lot, must meet the requirement in item § 150.0(k)3Ai (ON and OFF switch) and the requirements in either item § 150.0(k)3Aii (photocell and motion sensor) or item § 150.0(k)3Aiii (photo control and automatic time switch control, astronomical time clock, or EMCS).
§ 150.0(k)3B:	Residential Outdoor Lighting. For low-rise multifamily residential buildings, outdoor lighting for private patios, entrances, balconies, and porches; and outdoor lighting for residential parking lots and residential carports with less than eight vehicles per site must comply with either § 150.0(k)3A or with the applicable requirements in §§ 110.9, 130.0, 130.2, 130.4, 140.7 and 141.0.
§ 150.0(k)3C:	Residential Outdoor Lighting. For low-rise residential buildings with four or more dwelling units, outdoor lighting not regulated by § 150.0(k)3B or § 150.0(k)3D must comply with the applicable requirements in §§ 110.9, 130.0, 130.2, 130.4, 140.7 and 141.0.
§ 150.0(k)3D:	Residential Outdoor Lighting. Outdoor lighting for residential parking lots and residential carports with a total of eight or more vehicles per site must comply with the applicable requirements in §§ 110.9, 130.0, 130.2, 130.4, 140.7, and 141.0.
§ 150.0(k)4:	Internally illuminated address signs. Internally illuminated address signs must comply with § 140.8; or must consume no more than 5 watts of power as determined according to § 130.0(c).
§ 150.0(k)5:	Residential Garages for Eight or More Vehicles. Lighting for residential parking garages for eight or more vehicles must comply with the applicable requirements for nonresidential garages in §§ 110.9, 130.0, 130.1, 130.4, 140.6, and 141.0.
§ 150.0(k)6A:	Interior Common Areas of Low-rise Multi-Family Residential Buildings. In a low-rise multifamily residential building where the total interior common area in a single building equals 20 percent or less of the floor area, permanently installed lighting for the interior common areas in that building must be high efficacy luminaires and controlled by an occupant sensor.
§ 150.0(k)6B:	Interior Common Areas of Low-rise Multi-Family Residential Buildings. In a low-rise multifamily residential building where the total interior common area in a single building equals more than 20 percent of the floor area, permanently installed lighting in that building must: i. Comply with the applicable requirements in §§ 110.9, 130.0, 130.1, 140.6 and 141.0; and ii. Lighting installed in corridors and stairwells must be controlled by occupant sensors that reduce the lighting power in each space by at least 50 percent. The occupant sensors must be capable of turning the light fully on and off from all designed paths of ingress and egress.
Solar Ready Buildings:	
§ 110.10(a)1:	Single Family Residences. Single family residences located in subdivisions with ten or more single family residences and where the application for a tentative subdivision map for the residences has been deemed complete by the enforcement agency must comply with the requirements of § 110.10(b) through § 110.10(e).
§ 110.10(a)2:	Low-rise Multi-family Buildings. Low-rise multi-family buildings must comply with the requirements of § 110.10(b) through § 110.10(d).
§ 110.10(b)1:	Minimum Area. The solar zone must have a minimum total area as described below. The solar zone must comply with access, pathway, smoke ventilation, and spacing requirements as specified in Title 24, Part 9 or other Parts of Title 24 or in any requirements adopted by a local jurisdiction. The solar zone total area must be comprised of areas that have no dimension less than 5 feet and are no less than 80 square feet each for buildings with roof areas less than or equal to 10,000 square feet or no less than 160 square feet each for buildings with roof areas greater than 10,000 square feet. For single family residences the solar zone must be located on the roof or overhang of the building and have a total area no less than 250 square feet. For low-rise multi-family buildings the solar zone must be located on the roof or overhang of the building, or on the roof or overhang of another structure located within 250 feet of the building, or on covered parking installed with the building project, and have a total area no less than 15 percent of the total roof area of the building excluding any skylight area.*
§ 110.10(b)2:	Orientation. All sections of the solar zone located on steep-sloped roofs must be oriented between 110 degrees and 270 degrees of true north.
§ 110.10(b)3A:	Shading. The solar zone must not contain any obstructions, including but not limited to: vents, chimneys, architectural features, and roof mounted equipment.*
§ 110.10(b)3B:	Shading. Any obstruction located on the roof or any other part of the building that projects above a solar zone must be located at least twice the distance, measured in the horizontal plane, of the height difference between the highest point of the obstruction and the horizontal projection of the nearest point of the solar zone, measured in the vertical plane.*
§ 110.10(b)4:	Structural Design Loads on Construction Documents. For areas of the roof designated as solar zone, the structural design loads for roof dead load and roof live load must be clearly indicated on the construction documents.
§ 110.10(c):	Interconnection Pathways. The construction documents must indicate: a location for inverters and metering equipment and a pathway for routing of conduit from the solar zone to the point of interconnection with the electrical service (for single family residences the point of interconnection will be the main service panel); and a pathway for routing of plumbing from the solar zone to the water-heating system.
§ 110.10(d):	Documentation. A copy of the construction documents or a comparable document indicating the information from § 110.10(b) through § 110.10(c) must be provided to the occupant.
§ 110.10(e)1:	Main Electrical Service Panel. The main electrical service panel must have a minimum busbar rating of 200 amps.
§ 110.10(e)2:	Main Electrical Service Panel. The main electrical service panel must have a reserved space to allow for the installation of a double pole circuit breaker for a future solar electric installation. The reserved space must be: positioned at the opposite (load) end from the input feeder location or main circuit location; and permanently marked as "For Future Solar Electric".


HVAC SYSTEM HEATING AND COOLING LOADS SUMMARY

Project Name 96 Dorchester Drive - Corcorans	Date 6/4/2019
System Name Res HVAC	Floor Area 2,131


ENGINEERING CHECKS	SYSTEM LOAD					
Number of Systems	1	COIL COOLING PEAK			COIL HTG. PEAK	
Heating System		CFM	Sensible	Latent	CFM	Sensible
Output per System	56,000	837	17,543	1,142	497	19,361
Total Output (Btuh)	56,000		0			
Output (Btuh/sqft)	26.3		794			1,115
Cooling System			0			0
Output per System	47,500		0	0	0	0
Total Output (Btuh)	47,500		0			0
Total Output (Tons)	4.0		0			0
Total Output (Btuh/sqft)	22.3		794			1,115
Total Output (sqft/Ton)	538.4					
TOTAL SYSTEM LOAD			19,130	1,142		21,592

Air System	HVAC EQUIPMENT SELECTION				
CFM per System	1,545				
Airflow (cfm)	1,545	Bryant 556AN048-B/350MAV048060		34,809	8,531
Airflow (cfm/sqft)	0.73				
Airflow (cfm/Ton)	390.3				
Outside Air (%)	0.0%			34,809	8,531
Outside Air (cfm/sqft)	0.00				56,000
Note: values above given at ARI conditions		TIME OF SYSTEM PEAK		Aug 3 PM	Jan 1 AM

HEATING SYSTEM PSYCHROMETRICS (Airstream Temperatures at Time of Heating Peak)

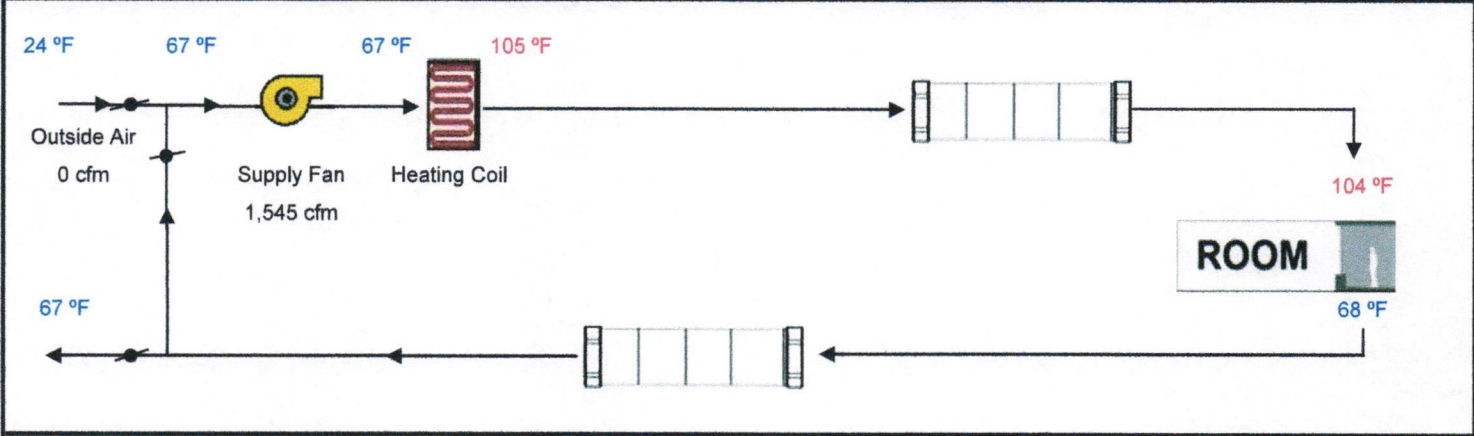



COOLING SYSTEM PSYCHROMETRICS (Airstream Temperatures at Time of Cooling Peak)

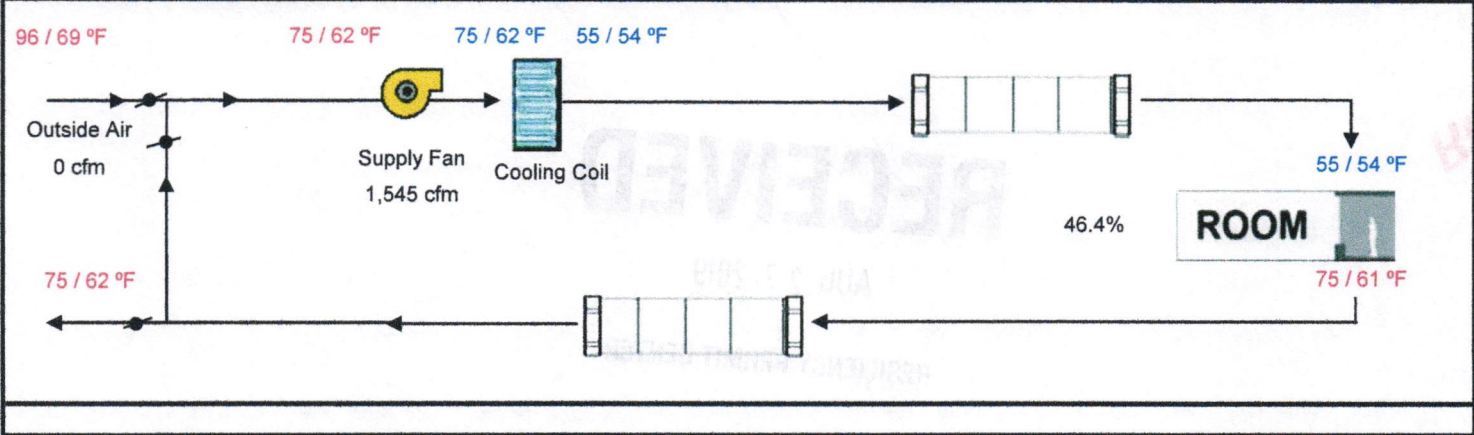

HVAC SYSTEM HEATING AND COOLING LOADS SUMMARY

Date 07/12/2019	Project Name 98 Dorchester Drive - Corcorans
Floor Area 2,131	System Name Res HVAC

ENGINEERING CHECKS				SYSTEM LOAD			
Number of Systems		1		COIL COOLING PEAK		COIL HTG PEAK	
Heating System				CFM		Sensible	
Output per System		88,000		Latent		CFM	
Total Output (Btu/h)		88,000		Total Room Loads		837	
Output (Btu/h)		25.3		Return Vented Lighting		17,843	
Cooling System				Return Air Ducts		0	
Output per System		47,500		Return Fan		0	
Total Output (Btu/h)		47,500		Ventilation		0	
Total Output (Tons)		4.0		Supply Fan		0	
Total Output (Btu/h)		25.3		Supply Air Ducts		1,115	
Total Output (Btu/h)		528.4		TOTAL SYSTEM LOAD		19,430	
Air System				TOTAL SYSTEM LOAD		1,143	
CFM per System		1,348		HVAC EQUIPMENT SELECTION			
Airflow (cm)		1,348		Byant 55EA1048-B150MAV1000		34,809	
Airflow (cm ²)		0.73		8.831		56,000	
Airflow (cfm)		300.3		Total Adjusted System Output		34,809	
Outside Air (%)		0.0%		(Adjusted for Peak Design conditions)		1,531	
Outside Air (cfm)		0.00		TIME OF SYSTEM PEAK		Avg 0.5M	

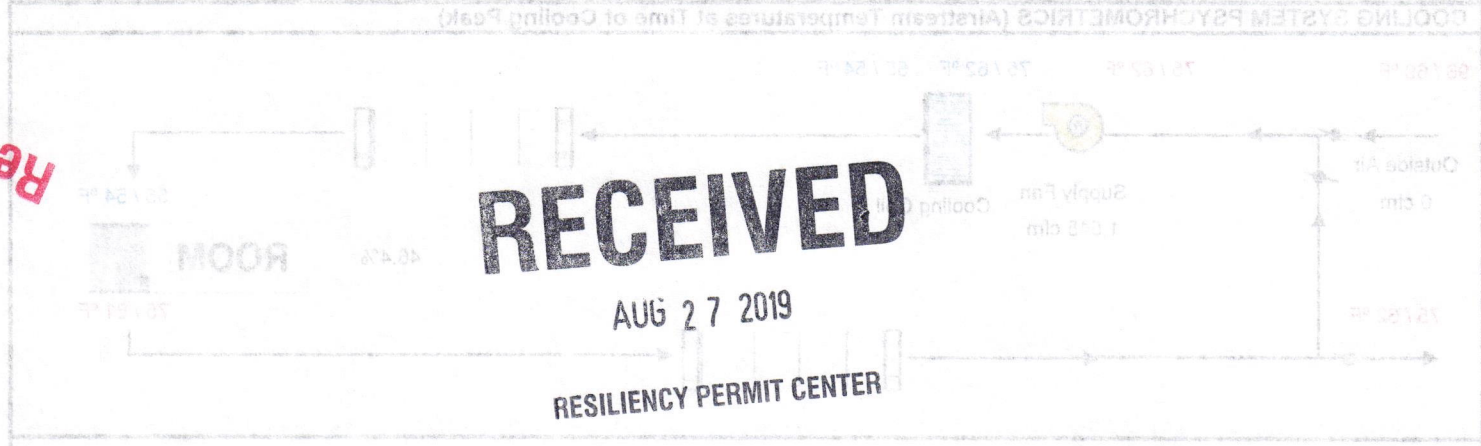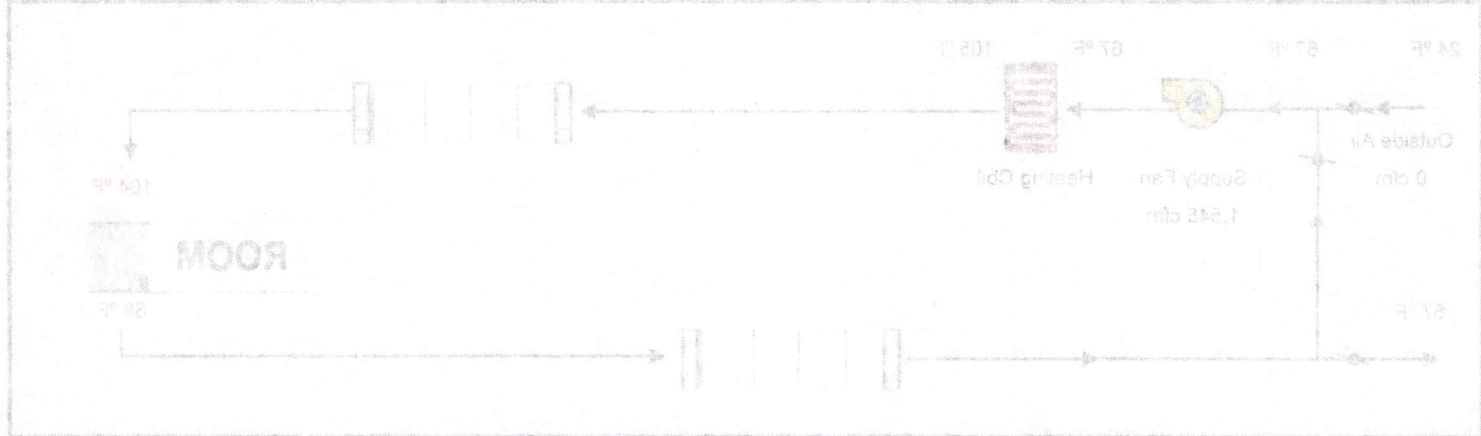

RECEIVED

AUG 27 2019

RESILIENCY PERMIT CENTER

Resili