



PROPERTY OWNER CONTACT INFO:
JEFF PETERSEN
(707) 794-8056
JPETERSEN176@SBCGLOBAL.NET


CONTOUR LINES ARE TAKEN FROM
SONOMA COUNTY VEGETATION MAPPING
AND LIDAR PROGRAM

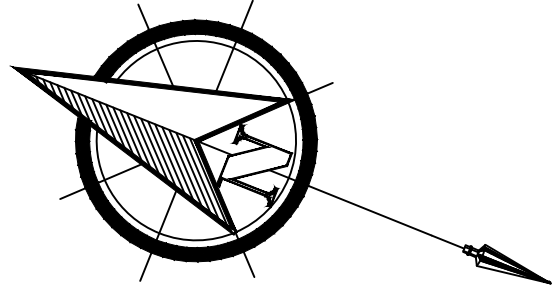

1 inch = 20 ft.

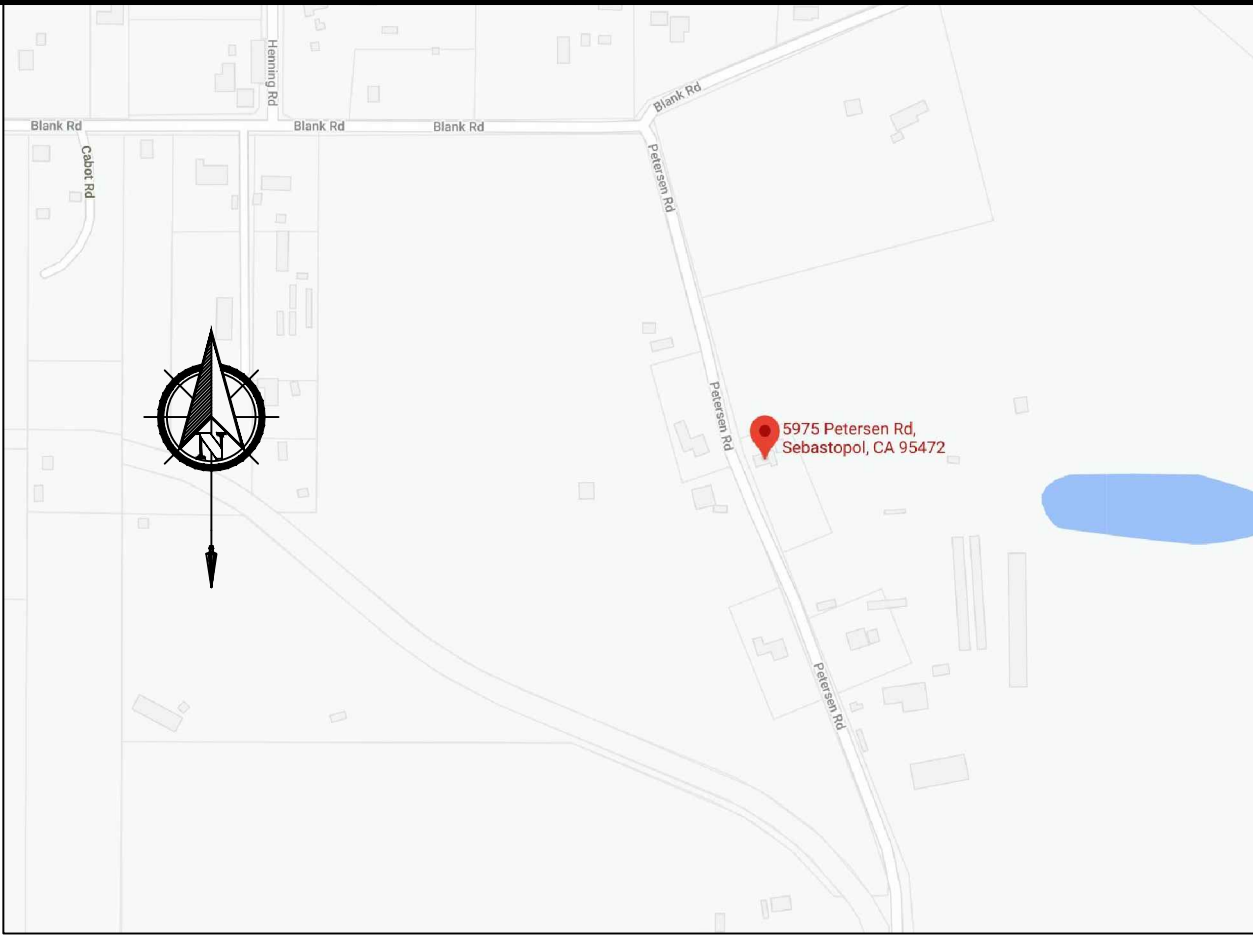

VICINITY MAP

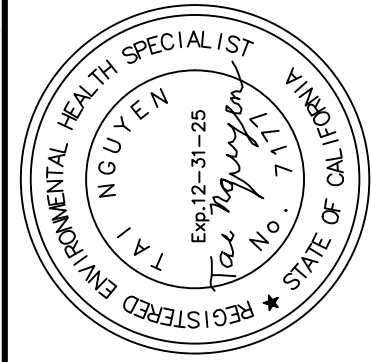

APEX SEPTIC DESIGN
P.O. BOX 11247
SANTA ROSA, CA 95406
(707) 322-5827
apexsepticdesign@gmail.com

LEGEND



WATER WELL



SOIL PROFILE HOLE

WATER LEVEL



WET WEATHER GROUNDWATER HOLE



PERFORMANCE WELL




CLEANOUT - TWO WAYS

APPROXIMATE BOUNDARY LINE

CONSTRUCTION NOTES:

- DESTROY EXISTING SEPTIC TANK
- INSTALL 4" ABS SCH 40 GRAVITY SEWER LINE WITH TWO-WAY CLEANOUT. SEWER LINE SHALL BE 1/8" PER FOOT DROP IN SLOPE.
- INSTALL 1,500 GALLONS CONCRETE SEPTIC TANK, IAPMO APPROVED. (SEE ILLUSTRATION ON SHEET 2)
- INSTALL 1,000 GALLONS CONCRETE SUMP TANK (SEE ILLUSTRATION ON SHEET 2).
- INSTALL A CONTROL PANEL (SEE ILLUSTRATION ON SHEET 2).
- INSTALL 2" Ø SCH 40 PVC SUPPLY PRESSURE SEWER LINE.
- INSTALL A MOUND LEACH BED (SEE ILLUSTRATIONS AND GUIDELINE ON SHEETS 2, 3, AND 4).

NEIGHBOR PARCEL
APN: 024-010-024

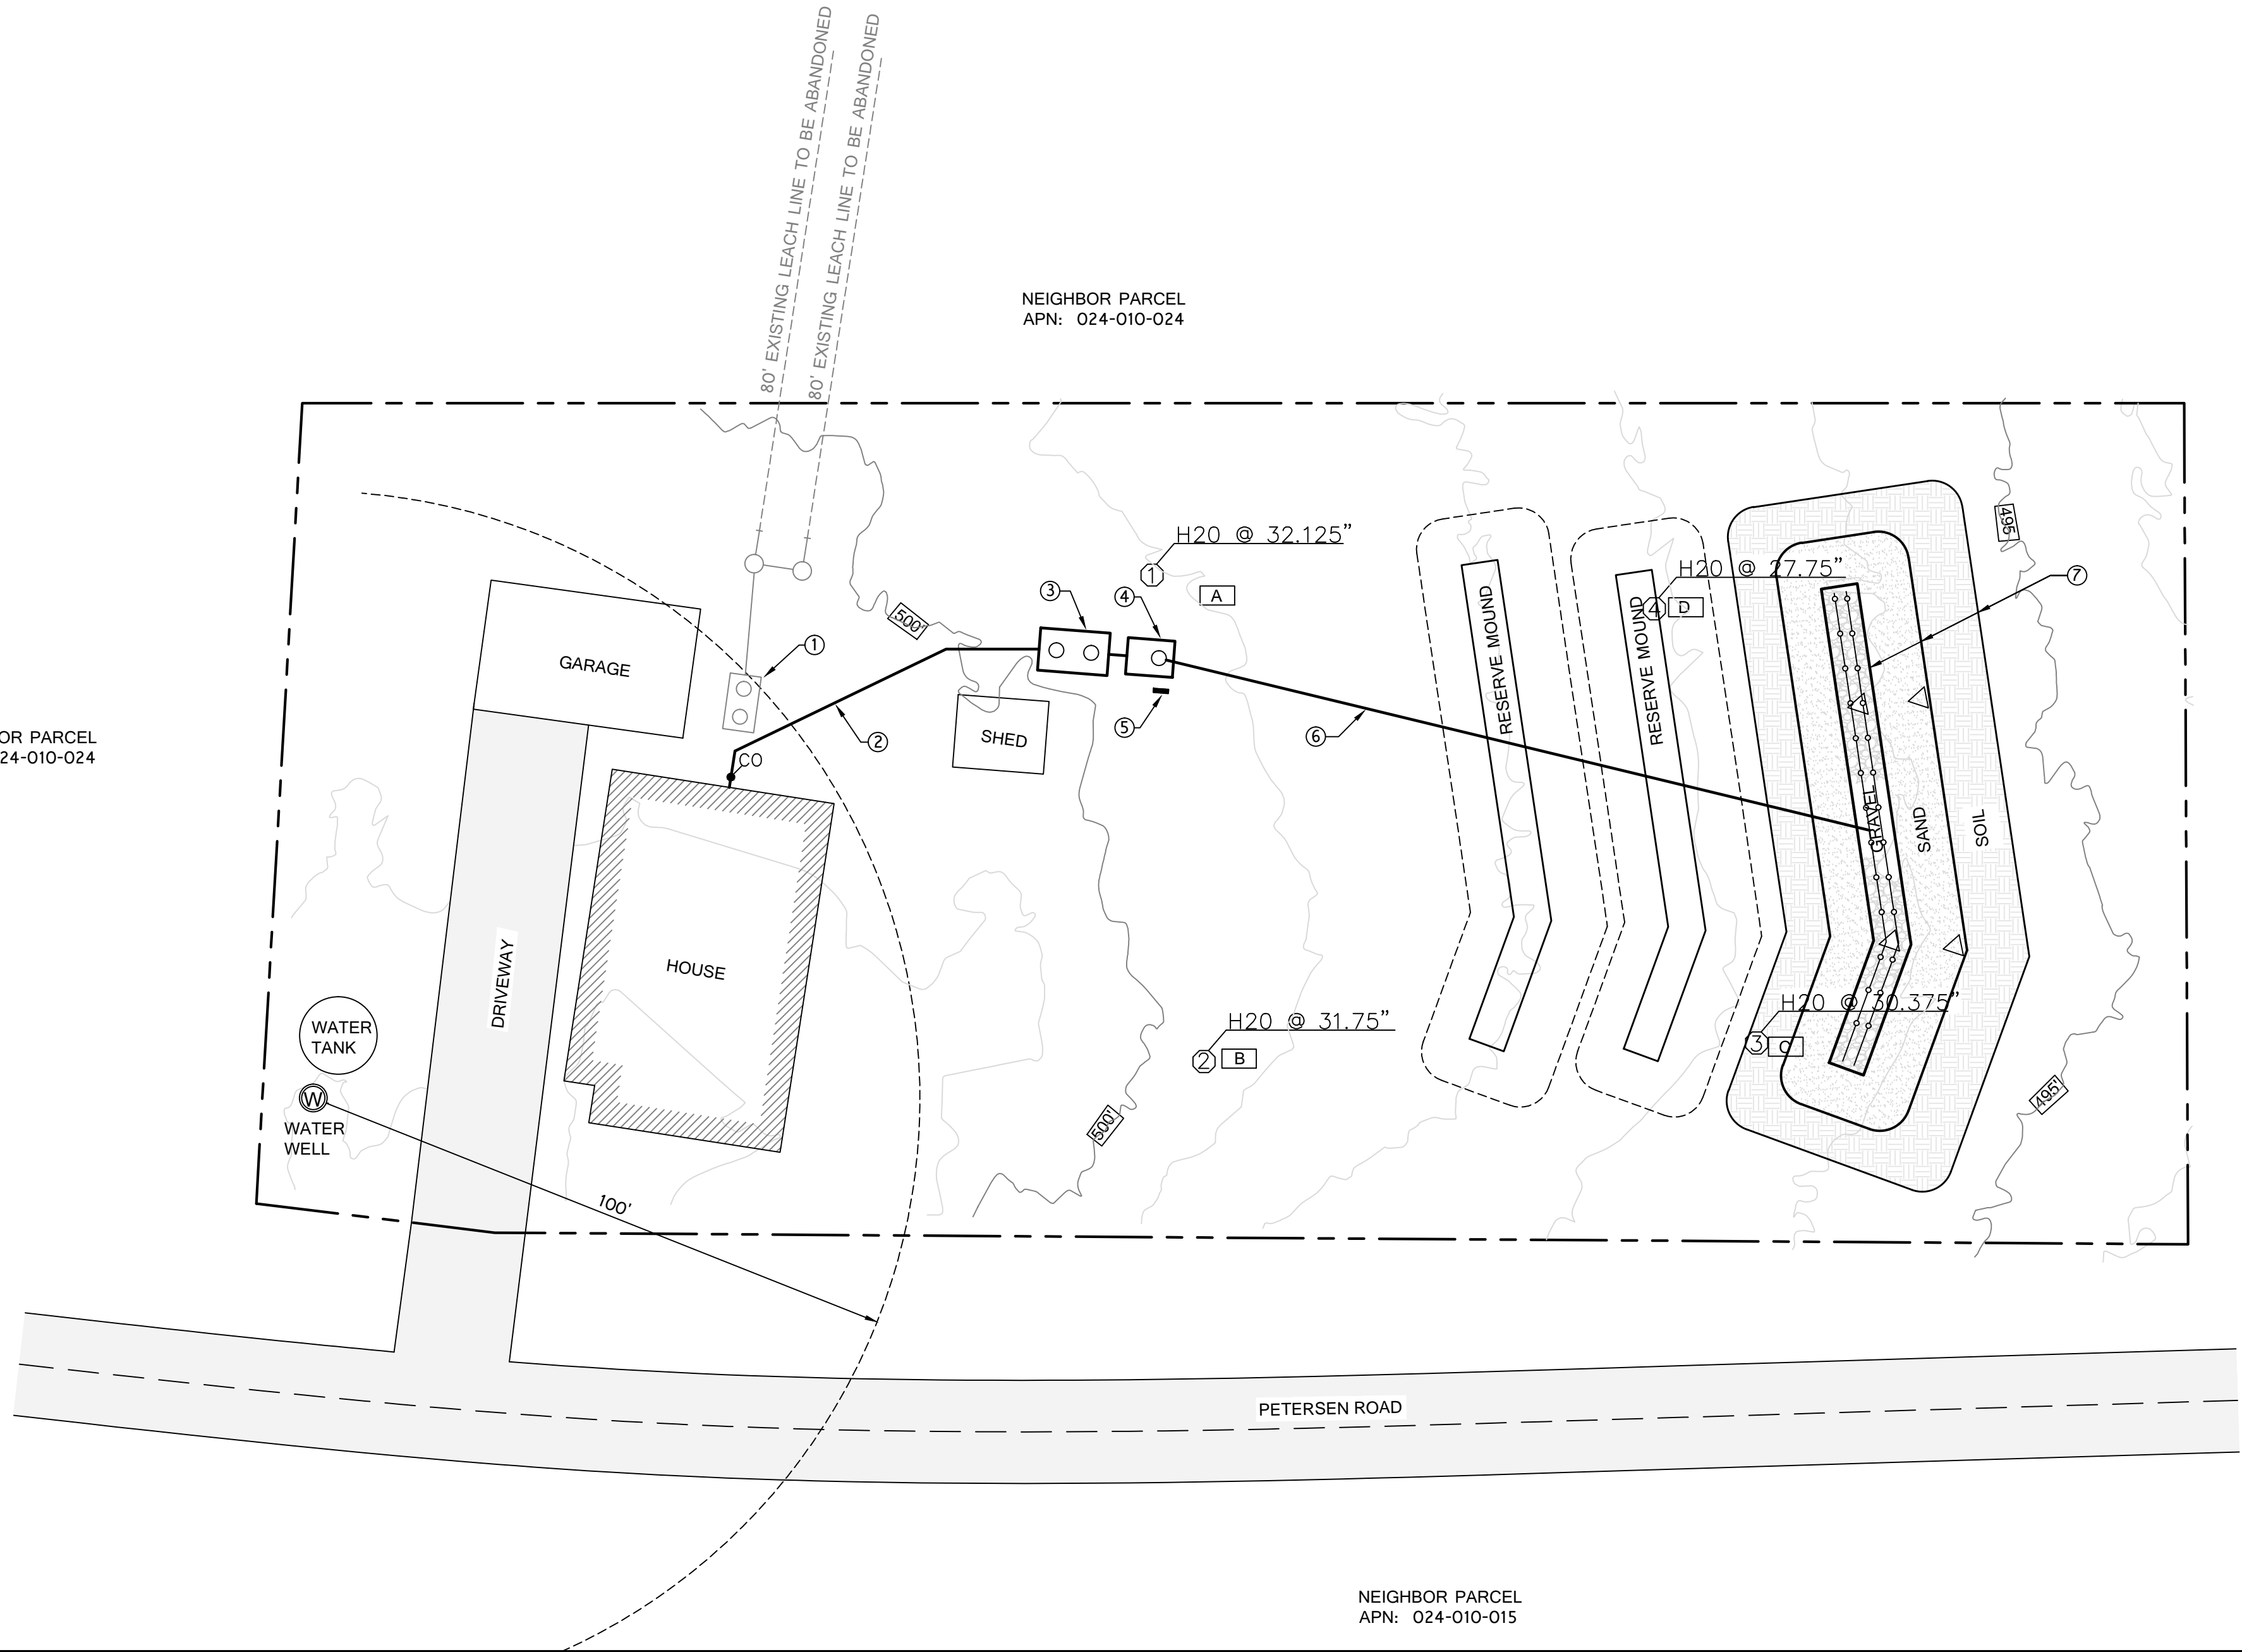

NEIGHBOR PARCEL
APN: 024-010-024

NEIGHBOR PARCEL
APN: 024-010-015

5975 PETERSEN ROAD
SEBATOPOL, CA 95472
APN: 024-010-014

MOUND SYSTEM PLAN

DRAWN:


TN

CHECKED:

TN

JOB NO:

No.	Revision
-----	----------



REQUIRED FEATURES FOR THE SUMP

- A. THE MINIMUM WORKING CAPACITY OF ALL SUMPS IS 300 GALLONS, INCLUDING:
 - A. THE DESIGN DOSE VOLUME.
 - B. A MINIMUM 200 GALLON ADDITIONAL STORAGE CAPACITY BETWEEN THE HIGH WATER ALARM AND INLET.
 - C. THE MINIMUM WORKING CAPACITY OF SUMPS FOR NON-STANDARD OWTs IS 500 GALLONS OR 3 TIMES THE DESIGNED DOSE, WHICHEVER IS GREATER.
 - D. ALTERNATIVE CONFIGURATIONS MAY BE APPROVED FOR SYSTEMS UTILIZING PRETREATMENT AND REPAIRS IF JUSTIFIED BY THE DESIGNER.
2. CONCRETE TANKS SHALL BE A MONOLITHIC CASTING OR JOINTS SEALED WITH APPROPRIATE SEALANTS.
 - A. CONCRETE TANKS SHALL BE MADE OF SULFATE-RESISTING CEMENT, SPECIFICATION C 150, TYPE II OR HIGHLY SULFATE-RESISTING CEMENT, SPECIFICATION C 150, TYPE V OR COATED WITH AN ASPHALT EMULSION OR EQUIVALENT ON THE INSIDE.
 - B. THE COATED INTERIOR SHALL BE ALLOWED TO DRY FOR AT LEAST 24 HOURS.
 - C. ASPHALT EMULSION OR TAR SHALL NOT BE USED AS JOINT SEALANTS.
3. SUMP TANKS SHALL BE CONSTRUCTED OF SOLID DURABLE MATERIALS, WHICH ARE NOT SUBJECT TO EXCESSIVE CORROSION AND DEGRADATION IN THE PRESENCE OF DOMESTIC SEWAGE AND SHALL BE WATERTIGHT.
 - A. THEY SHALL MEET THE IAPMO CONSTRUCTION STANDARDS FOR SEPTIC TANKS OF THE SAID MATERIAL (GLASS-FIBER-REINFORCED POLYESTER, POLYETHYLENE, SYNTHETIC FIBER REINFORCED).
 - B. WOOD AND/OR METAL TANKS ARE NOT ALLOWED.
4. ALL SUMPS SHALL HAVE A RISER THAT EXTENDS TO AT LEAST 2 INCHES ABOVE THE FINISHED GRADE.
 - A. RISERS SHALL BE SEALED WATERTIGHT TO THE SUMP CHAMBER WITH MATERIALS SUITED FOR THE SPECIFIC APPLICATION.
 - B. WOOD RISERS ARE NOT ALLOWED.
 - C. RISERS AND LIDS IN TRAFFIC AREAS SHALL BE TRAFFIC RATED AND MAY BE FLUSH WITH THE GROUND ELEVATION.
5. ALL PIPES AND/OR ELECTRICAL CONDUITS ENTERING THE SUMP TANK OR RISER SHALL BE SEALED TO MAKE THE PASSAGE GAS AND WATER TIGHT.
 - A. IF THE PIPES AND/OR ELECTRICAL CONDUITS ENTER A SYNTHETIC TANK OR PLASTIC RISER, RUBBER GROMMETS SHALL BE USED
 - B. NON-SHRINK GROUTS SHOULD BE USED WITH CONCRETE TANKS OR RISERS.
6. SUMPS ON DOWNHILL RUNS SHALL BE PLACED WITHIN 30 FEET OF THE LEACHFIELD, UNLESS GREATER DISTANCES ARE ALLOWED. WHEN PRACTICAL, SUMPS SHALL BE LOCATED AT A LOWER ELEVATION THAN THE LEACHFIELD.
 - A. THE SUMP TANK LOCATION MUST BE ACCESSIBLE FOR A SEPTIC TANK PUMPER TO PUMP THE TANK.
7. A PRE-SCREENING DEVICE OR FILTER CAPABLE OF SCREENING SOLIDS IN MINIMUM 3/16 INCHES SIZE SHALL BE INSTALLED IN THE SEPTIC TANK OR SUMP CHAMBER TO ASSIST IN PREVENTING SUSPENDED SOLIDS FROM REACHING THE PUMP.
8. WASTEWATER SHALL EXIT THE SUMP ONLY THROUGH PUMP AND PRESSURE LINES. GRAVITY OVERFLOWS ARE PROHIBITED.

REQUIRED FEATURES OF THE PUMP ARE AS FOLLOWS:

1. FLOAT CONTROLS FOR THE PUMP AND AUDIO/VISUAL ALARM SHALL BE MOUNTED TO A SCHEDULE 40 PVC POLE, MOUNTED INSIDE A PUMP CHAMBER, WHICH CAN BE REMOVED FOR MAINTENANCE.
2. CONTROL FLOATS SHALL BE ATTACHED TO THE PVC POLE BY PLASTIC TIE STRAPS OR PLASTIC FLOAT COLLARS. A. STAINLESS STEEL STRAPS WILL NOT BE ACCEPTED.
3. THE PUMP SHALL BE MOUNTED A MINIMUM OF 4 INCHES ABOVE THE BOTTOM OF THE SUMP CHAMBER. A. IF APPLICABLE, NON-CORROSIVE MATERIALS SHALL BE USED TO SUPPORT THE PUMP.
4. FOR THE SITUATIONS WHERE A PUMP MUST BE INSTALLED IN THE SECOND CHAMBER OF THE SEPTIC TANK, THE PUMP SHALL BE PLACED IN A SCREENED PUMP VAULT WITHIN THE SECOND CHAMBER.
 - A. MICRODOOSING SHALL BE REQUIRED TO MINIMIZE SWINGS IN THE LIQUID LEVEL.

REQUIRED ELECTRICAL FEATURES ARE AS FOLLOWS


- C. ALL MATERIALS, CONNECTIONS, AND SPECIFICATIONS SHALL MEET THE CALIFORNIA ELECTRIC CODE. A. IN ALL CASES IN WHICH A SUMP WITH PUMP IS USED FOR AN OWTS, THE CONTRACTOR/OWNER SHALL OBTAIN AN ELECTRICAL PERMIT FROM PERMIT AUTHORITY OR CITY BUILDING DEPARTMENT HAVING JURISDICTION.
- B. THE PERMIT AUTHORITY SHALL BE RESPONSIBLE FOR INSPECTION AND APPROVAL OF ALL ELECTRICAL CODE REQUIREMENTS.
- C. DISCONNECTING MEANS (CONTROL PANEL OR DISCONNECTING SWITCH) SHALL BE LOCATED IN SIGHT FROM THE PUMP LOCATION PER THE COUNTY ADOPTED ELECTRICAL CODE.
2. THE ALARM SHALL BE EQUIPPED WITH: A. A LOUD (87 DECIBELS AT A 10-FOOT MINIMUM HORIZONTAL DISTANCE FROM THE ALARM LOCATION) AUDIO ALARM OPERATED BY A FLOAT SWITCH OR SWITCHES TO INDICATE AN "ALARM" SITUATION.
 - B. A MINIMUM SIZED 7/8-INCH DIAMETER RED LIGHT SHALL BE MOUNTED ON THE FACE OF THE PANEL, WHICH SHALL GLOW AS LONG AS THE "ALARM" CONDITION EXISTS.
 - C. A MOMENTARY "ALARM TEST/ALARM SILENCE" SWITCH TO TEST THE ALARM LIGHT AND HORN TO SIMULATE AN "ALARM" CONDITION AND TO SILENCE THE AUDIO ALARM HORN.
3. AN APPROVED LISTED MODEL OR TYPE OF FLOAT SWITCH SHALL BE USED TO ACTIVATE EACH PUMP. THE ALARM/CONTROL PANEL SHALL BE EQUIPPED WITH A MOTOR CONTACTOR FOR THE PUMP AND A PUMP HAND/OFF/AUTOMATIC SWITCH TO MANUALLY RUN THE PUMP BYPASSING THE CONTROL PANEL AUTOMATIC MODE AND TO TEST THE ALARM.
4. POWER SUPPLY TO EACH CIRCUIT BREAKER IN THE CONTROL PANEL SHALL BE FROM A SEPARATE DEDICATED CIRCUIT WITH CIRCUIT PROTECTION, OF EQUIVALENT OR HIGHER AMPERE RATING, AT THE POWER SUPPLY PANEL.
 - A. THE ALARM/CONTROL PANEL SHALL BE EQUIPPED INTERNALLY WITH SEPARATE CIRCUIT PROTECTION FOR THE CONTROL AND PUMP CIRCUITRY.
 - I. MULTIPLEX (MORE THAN 1 PUMP) SYSTEMS SHALL HAVE SEPARATE POWER SUPPLY CIRCUITS.
 - II. SEPARATE CIRCUITS ARE REQUIRED FOR CONTROLS AND EACH PUMP.
 - III. JOINT CIRCUITS MAY BE ACCEPTABLE FOR EXISTING SUMP/PUMP SYSTEMS THAT WERE INSTALLED PRIOR TO THIS REQUIREMENT IF FUSED PURSUANT TO THE CURRENT ELECTRICAL CODE.
- B. PUMP PROTECTION SHALL BE PROVIDED BY A THERMAL MAGNETIC CIRCUIT BREAKER FOR OVERLOAD PROTECTION.
 - I. IF THE PUMP IS SINGLE-PHASE, THE MOTOR WINDINGS SHALL HAVE INTERNAL THERMAL OVERLOAD PROTECTION.
 - II. IF THE PUMP IS 3-PHASE, THE CIRCUIT PROTECTION IN THE ALARM/CONTROL BOX SHALL BE EQUIPPED WITH AN ADJUSTABLE THERMAL OVERLOAD PROTECTION.
5. BELOW GRADE ELECTRICAL SPLICES SHALL BE PLACED IN A SONOMA COUNTY APPROVED PULL BOX INSTALLATION OR A SONOMA COUNTY APPROVED EXTERNAL SPLICE BOX WITH WATERPROOF SPLICE CONNECTORS.
 - A. TRAFFIC-RATED PULL BOXES SHALL BE USED IN TRAFFIC AND ADJACENT AREAS.
6. ELECTRICAL NON-METALLIC SPLICE BOXES MAY BE PLACED WITHIN THE SUMP CHAMBER FOR EXISTING SUMP/PUMP SYSTEMS THAT WERE INSTALLED PRIOR TO THIS REQUIREMENT. THEY SHALL BE GAS-TIGHT BOXES WITH WATERPROOF SPLICE CONNECTORS.
7. THE PUMP POWER LEAD AND THE FLOAT SWITCH CONTROL WIRES MAY RUN IN A COMMON CONDUIT. HIGH VOLTAGE AND LOW VOLTAGE CONDUCTORS SHALL BE RUN IN SEPARATE CONDUITS.
 - A. ALL CORDS GOING INTO THE SUMP SHALL BE INDIVIDUALLY SEALED WITH NON-METALLIC GAS TIGHT FITTINGS IN EITHER THE RISER, JUNCTION BOX OR ALARM/CONTROL PANEL AS APPROPRIATE.
 - B. METALLIC GAS TIGHT FITTINGS ARE NOT ALLOWED.
 - C. ALL EXPOSED PVC CONDUIT SHALL BE SCHEDULE 80.

REQUIRED FEATURES FOR THE SUMP, CONTINUE:

- A. THE CONTROL PANEL AND ITS CONTENTS SHALL BE UL LISTED.
- A. THE CONTROL PANEL SHALL BE PLACED IN AN EASILY ACCESSIBLE LOCATION.
- B. A NON-RESETTABLE DOSE COUNTER SHALL BE INSTALLED IN CONTROL BOXES UTILIZED FOR NON- STANDARD OWTs.
- C. IF A DOSE COUNTER IS NOT PROVIDED, A NON-RESETTABLE FLOW METER SHALL BE PROVIDED ON THE OUTGOING LINE TO THE DISPERSAL FIELD. ADDITIONALLY, SYSTEMS WITH FLUSH MODES SHALL BE EQUIPPED WITH A FLOW METER ON THE RETURN LINE. THE FLOW METER SHALL READ IN GALLONS PER MINUTE AND TOTAL GALLONS.
- D. THE CONTROL PANEL SHALL BE EQUIPPED SO SETTINGS CAN BE ADJUSTED MANUALLY ON-SITE.
- E. CONTROL BOXES THAT MUST BE OPENED TO VIEW THE DOSE COUNTER SHALL BE EQUIPPED WITH A CLEAR PLASTIC OR PYREX SAFETY SHIELD INSIDE THE CONTROL BOX.
- F. THE CONTROL BOX SHALL BE LABELED "CAUTION-ELECTRICAL HAZARD."
- G. THE DOSE SETTINGS (TIME OR GALLONS), CALCULATED DOSE VOLUME AND FLOAT SETTINGS SHALL BE POSTED ON THE INSIDE OF THE PANEL.
9. ALL EXTERIOR MOUNTED ALARM AND CONTROLLER ENCLOSURE SHALL BE NEMA TYPE 4. IF THE ALARM/CONTROLLER IS MOUNTED MORE THAN 75 FEET FROM ANY RESIDENCE OR COMMERCIAL STRUCTURE SERVED BY THE SYSTEM, A SEPARATE AUDIBLE/VISIBLE ALARM SHALL BE PROVIDED AT THE PRIMARY STRUCTURE CONNECTED TO THE OWTs.
- A. THE ENCLOSURE FOR THE REMOTE AND AUDIO/VISUAL ALARM SHALL BE NEMA TYPE 1 IF MOUNTED INDOORS.


REQUIRED FEATURES OF SEWAGE PIPING ARE AS FOLLOWS:

1. THE EFFLUENT LINE ENTERING THE SUMP SHALL BE MINIMUM OF 3 INCH DIAMETER, ABS SCH 40 OR PVC SCH 40, AND SHALL BE SEALED WITH A COUPLING INTEGRALLY CAST INTO THE TANK, A PROPERLY FIT NEOPRENE GROMMET OR WITH NON-SHRINK GROUT AS APPROPRIATE. A. THE EFFLUENT LINE SHALL BE TURNED DOWN WITH A SANITARY TEE FITTING AND DROP THAT EXTEND TO WITHIN 4 INCHES OF THE TANK FLOOR.
2. MINIMUM 1 INCH PVC SCHEDULE 40 FROM PUMP TO DISPERSAL FIELD IS REQUIRED WITH:
 - A. A 1/8-INCH DIAMETER ANTI-SIPHON AND AIR VENT HOLE LOCATED BETWEEN THE PUMP AND CHECK VALVE ANGLED DOWN AND AWAY FROM THE FLOATS;
 - B. PVC CHECK VALVE;
 - C. PVC GATE OR BALL VALVE AND UNION(S).
3. BRASS TYPE FITTINGS, VALVES, AND PIPING ARE PROHIBITED IN SUMP CHAMBERS.
4. HIGH POINTS IN THE TRANSMISSION LINE AFTER THE SUMP MAY REQUIRE AN "AIR RELIEF VALVE" DEPENDING ON THE DESIGN SITUATION.

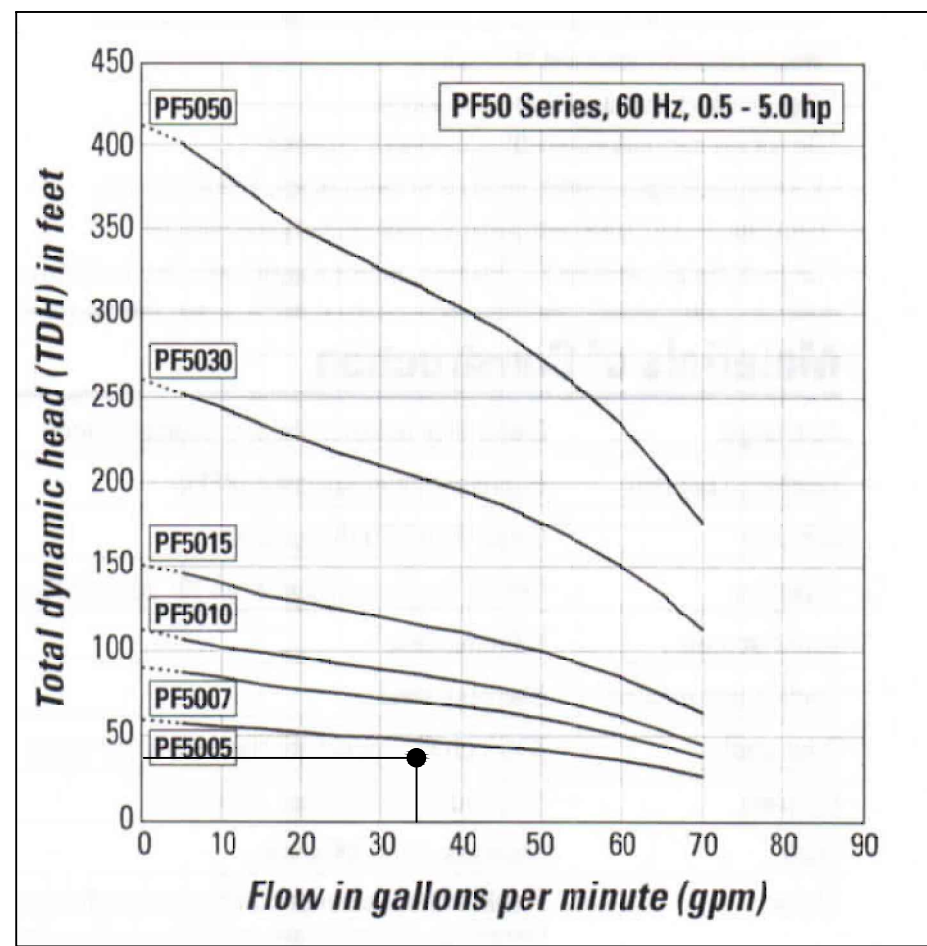

PUMP CURVE

<u>PUMP SIZING</u>			= Enter Field					
(A) Width of Gravel Bed								
			= 6	Feet				
(B) Length of Gravel Bed								
			= 80	Feet				
Total Length of Supply Line (From pump to manifold)								
			= 150	Feet				
Supply Line diameter								
			= 2	Inches				
Lateral Specification (Center Feed):								
No. of Lateral Legs			= 4	Feet Inches Feet Feet				
Length per Lateral Leg	=	(B/2) - 0.5'	= 39.5					
Lateral Diameter			= 1					
Spacing between laterals			= 2					
Hole Diameter	(Select From 1/8, 3/16, or 1/4")	=	1/8"					
Hole Spacing			= 2	Feet				
System Discharge: Pump to Leach Field (SDPL)								
Total Number of Holes			= 79.00	Holes				
(Length per Lateral Leg X No. of Laterals) ÷ Hole Spacing								
Discharge Rate per Hole for 5' Distal Head @	1/8"	Diameter hole	= 0.41	Gal/Min Gal/Min Gal/Min				
Req. Discharge Rate =	Total No. Holes X Discharge Rate per Holes	=	32.39					
	(SDPL) , Use	=	33					
System Discharge: Single Longest Lateral (SDSL)								
Total Number of Holes =	Single Longest Lateral Leg ÷ Hole Spacing	=	19.75	Holes				
Discharge Rate per Hole for 5' Distal Head @	1/8"	Diameter hole	= 0.41	Gal/Min				
Req. Discharge Rate =	Total No. Holes X Discharge Rate per Holes	=	8.10	Gal/Min				
	(SDSL) , Use	=	8.10	Gal/Min				
Pump Sizing:								
1. Elevation Head (in Feet) From Pump to D-box:								
500	Highest Elev. Point	-	485	Pump Elev.	=	15	Feet	
2. Pressure Head (Squirt Height)					=	5	Feet	
3. Supply Line Friction Loss From					2 "	Diameter Supply Line & Manifold:		
		<u>No. of Fitting</u>	<u>Equivalent Feet</u>					
Gate Valve	1	X	1.4	= 1.4	Feet			
Check Valve	1	X	17	= 17	Feet			
Tee	2	X	11	= 22	Feet			
90° Elbow	4	X	9	= 36	Feet			
45° Elbow	4	X	4	= 16	Feet			
Coupling/Quick Disconnect	1	X	2	= 2	Feet			
		Total Friction Loss From Fitting	=	94.40	Feet			
Total length = Supply Line Length + Total Friction Loss From Fitting					=	244.40	Feet	
Friction Loss Per 100 feet of Pipe (From Chart)					=	2.58	Feet	
Supply Line Friction Loss = (Total Length) X (Friction Loss Per 100 feet of Pipe ÷ 100)					=	6.31	Feet	
4. Lateral Friction Loss From					1 "	Diameter Lateral:		
		<u>No. of Fitting</u>	<u>Equivalent Feet</u>					
Gate Valve	4	X	0.9	= 3.6	Feet			
Check Valve	0	X	11	= 0	Feet			
Tee	0	X	7	= 0	Feet			
90° Elbow	0	X	7	= 0	Feet			
45° Elbow	0	X	3	= 0	Feet			
Coupling/Quick Disconnect	4	X	1	= 4	Feet			
		Total Friction Loss From Fitting	=	7.60	Feet			
Total Lateral Length = length of Lateral Leg X No. Lateral Legs					=	158	Feet	
Total length = Total Lateral Length + Total Friction Loss From Fitting					=	165.60	Feet	
Friction Loss Per 100 feet of Pipe (From chart)					Gal/Min = 8.10	=	5.10	Feet
Lateral Line Friction Loss = (Total Length) X (Friction Loss Per 100 feet of Pipe ÷ 100)					=	8.45	Feet	
5. Total Dynamic Head					=	34.75	Feet	
Elevation Head + Pressure Head + Supply Line Friction Loss + Lateral Friction Loss								
Pump Must Discharge 33 Gallons Per Minutes Against A Head of 35 Feet								
Recommend Pump: Orenco High Head Pump PF500511, 0.5 HP, 115V								

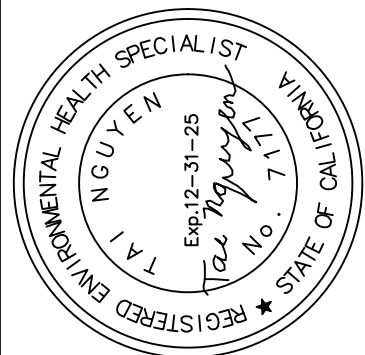

APEX SEPTIC DESIGN
P.O. BOX 11247
SANTA ROSA, CA 95406
(707) 322-5827
apexsepticdesign@gmail.com

5975 PETERSEN ROAD
SEBATOPOLE, CA 95472
APN: 024-010-014

MOUND SYSTEM PLAN

DRAWN:

TN

CHECKED:

TN

JOB NO:

[illegible]