


# PARTIAL SITE PLAN
# SHOWN FOR REFERENCE ONLY
# N.T.S.

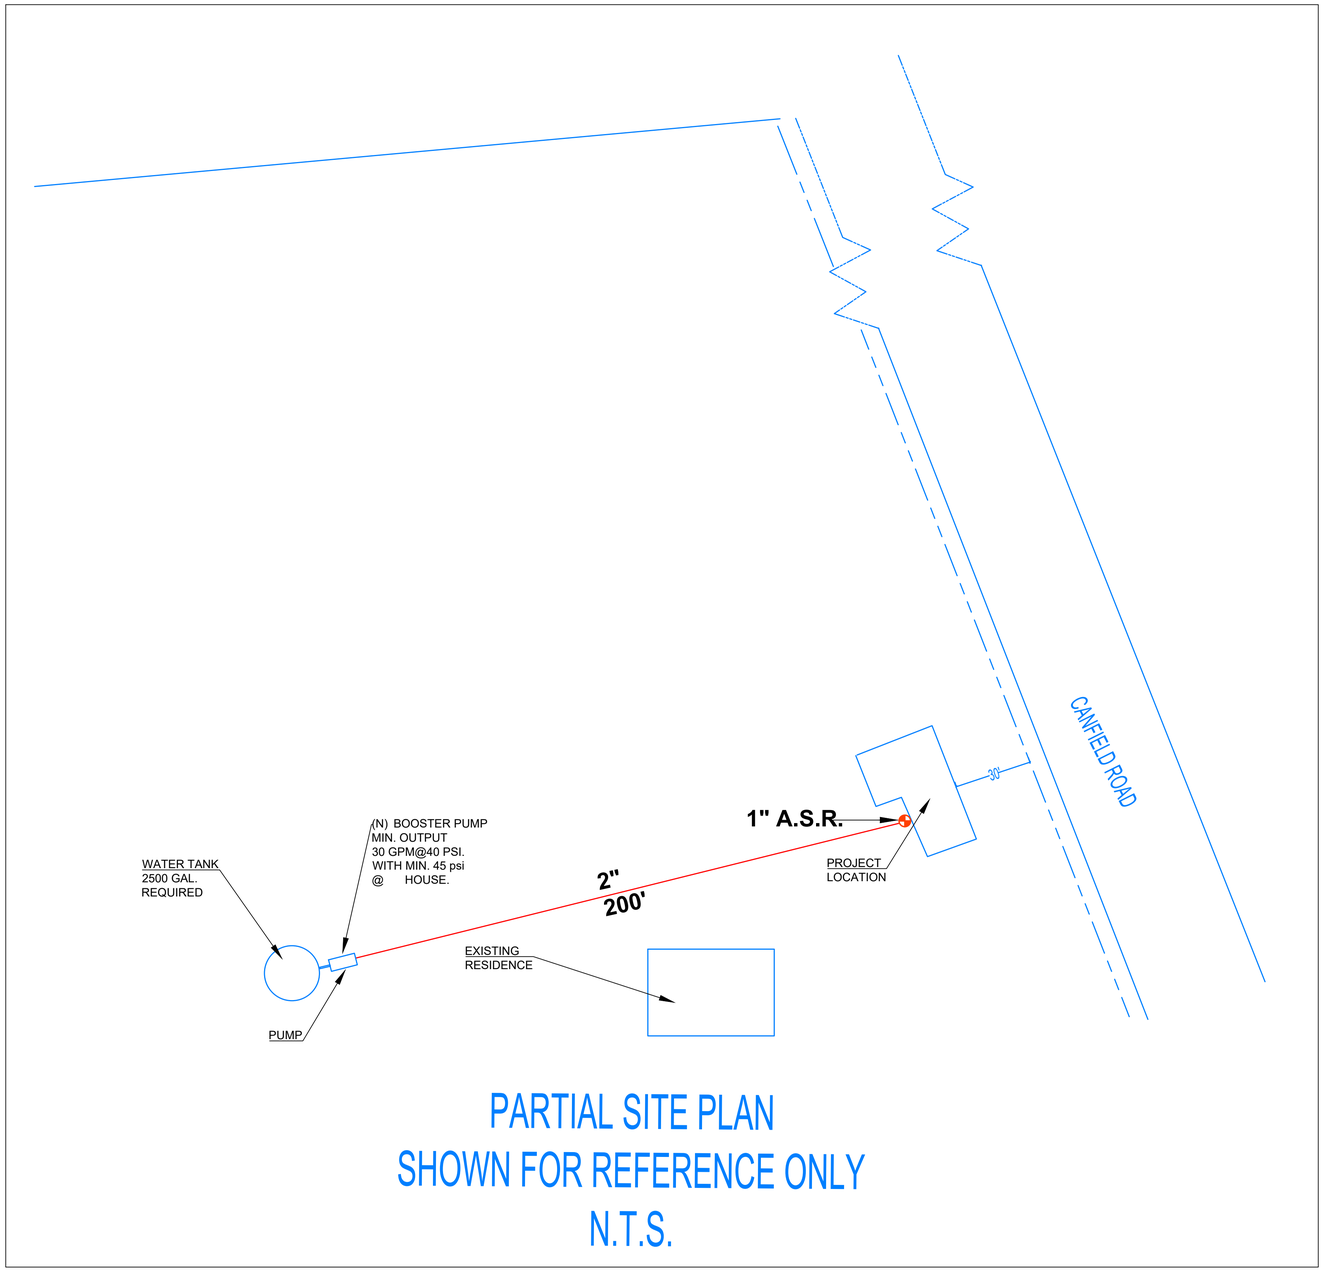


## WATER SOURCE & RISER DETAIL
Scale: NTS

| HANGER AND SUPPORT SPACING | | |
|---|---|---|
| PIPE SIZE, NOMINAL INCHES | MAXIMUM SUPPORT SPACING IN FEET | WEIGHT WATER PIPE IN LBS/FT |
| 3/4" (DN20) | 5-1/2' | .0427 |
| 1" (DN25) | 6' | .0674 |
| 1-1/4" (DN32) | 6-1/2' | 1.078 |
| 1-1/2" (DN40) | 7' | 1.412 |
| 2" (DN50) | 8' | 2.223 |

A sign or valve tag shall be installed at the main shutoff valve to the water distribution system stating the following: "Warning, the water system for this home supplies Fire sprinklers that require certain Flows and pressures to Fight a Fire. Devices that restrict the Flow or decrease the pressure or automatically shut off the water to the Fire sprinkler system, such as water softeners, Filtration systems and automatic shutoff valves, shall not be added to this system without a review of the Fire sprinkler system by a Fire protection Authority

GENERAL FIRE PROTECTION NOTES 13D:

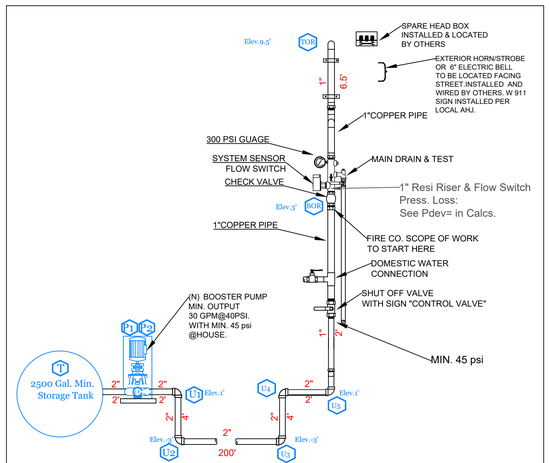1. SYSTEM DESIGN, INSTALLATION, AND TESTING SHALL BE IN ACCORDANCE WITH NFPA 13D 2022 ed. AND THE LOCAL AHJ.
2. ALL WORK SHALL BE INSTALLED IN ACCORDANCE WITH THE APPLICABLE STANDARDS OF NFPA 13D, AND CITY AND STATE REQUIREMENTS.
3. SYSTEM PIPING TO BE OF CPVC PIPE AND FITTINGS MEETING CRITERIA OF ASTM AND NFPA 13D.
4. ALL MATERIAL AND DEVICES TO BE U.L. AND/OR FM APPROVED. ALL DEVICES SHALL BE NEW AND FREE OF DEFECTS.
5. HANGERS AND SPACING SHALL BE INSTALLED PER NFPA 13D.
6. NOTE HEAD TYPES IN LEGEND PLAN.
7. ANY AND ALL ALARM SYSTEM WIRING AND INSTALLATION IS BY OTHERS.
8. 2022 CBC-INTERNATIONAL EXISTING BUILDING CODE, APPENDIX CHAPTERS A2, A3 AND A4.
9. EXISTING BUILDING CODE, GREEN BUILDING CODE,HISTORICAL BUILDING CODE.
10. CALIFORNIA BUILDING CODE. TITLE 24, PART 6


CB PLUMBING
&
FIRE PROTECTION
***Lic. 716080 C16-C36***
***P.O. BOX 1352***
***Kelseyville, Ca. 95451***

Contractor:
Chris Brown 707-350-5179

**cbplumbing3@gmail.com**


| No. | REVISIONS DESCRIPTION | Date |
|---|---|---|
| 1 | | |
| | | |
| | | |
| | | |
| | | |
| | | |
| | | |
| | | |
| | | |

LICENSED FIRE PROTECTION CONTRACTOR
CB PLUMBING & FIRE PROTECTION
CLASSIFICATION C16-C36
LICENSE NO. 716080
STATE OF CALIFORNIA

Chris Brown

RACHEL BORING AEDU

4200 CANFIELD RD.
Sebastopol, CA.
95472
APN: 025-110-006

Date: Nov. 22, 2024
Drawn By: BA
Scale: AS NOTED
SHEET NUMBER
FP-1